
Market Manual 7: System Operations

**Part 7.3: Outage
Management**

Issue 47.1-MRP
July 14, 2023

This *market manual* is provided for stakeholder engagement purposes. Please note that additional changes to this document may be incorporated as part of future engagement in MRP or other *IESO* activities prior to this *market manual* taking effect.

This market manual outlines the process market participants must follow in submitting outage requests for facilities.

Document Change History

Issue	Reason for Issue	Date
For changes prior to 2010 2018, refer to versions 23 version 44.0 and prior.		
For changes from 2011 through 2014, refer to versions 32.0 and prior.		
28.0	Issue released in advance of Baseline 33.1 to update IESO logo	March 31, 2015
29.0	Issue released for Baseline 34.1	December 2, 2015
30.0	Issue released in advance of Baseline 36.0	June 21, 2016
31.0	Issue released in advance of Baseline 36.1	October 26, 2016
32.0	Issue released for Baseline 37.1	June 7, 2017
33.0	Issue released for Baseline 39.0	March 7, 2018
34.0	Issue released for Baseline 39.1	June 6, 2018
35.0	Issue released for Baseline 40.0	September 12, 2018
36.0	Issue released in advance of Baseline 40.1	November 14, 2018
37.0	Issue released for Baseline 41.0	March 6, 2019
38.0	Issue released for Baseline 41.1	June 5, 2019
39.0	Issue released in advance of Baseline 42.1	October 15, 2019
40.0	Issue released in advance of Baseline 43.1. These changes are effective for obligations arising from the demand response auction held in December 2019, for the commitment period beginning May 1, 2020.	April 23, 2020
41.0	Issue released in advance of Baseline 43.1. These changes are effective for obligations arising from the capacity auction and applicable to capacity obligations for any commitment period beginning on or after May 1, 2021.	May 4, 2020
42.0	Issue released in advance of Baseline 44.0	June 29, 2020
43.0	Updated to meet accessibility requirements pursuant to the <i>Accessibility for Ontarians with Disabilities Act</i> .	December 2, 2020
44.0	Issue released in advance of Baseline 45.0. Updated to include electricity storage participation.	February 26, 2021 2020
45.0	Issue released for Baseline 46.0.	September 15, 2021

46.0	Issue released for Baseline 48.0	September 14, 2022
47.0	Issue released in advance of Baseline 48.1	September 19, 2022
<u>47.1</u> Document ID	Document Title <u>Updated for stakeholder engagement to reflect Market Renewal Program</u>	<u>July 14, 2023</u>
N/A		

Table of Contents

Table of Contents	i
List of Figures	iv
List of Tables	v
Table of Changes	vii
Market Manuals	viii
Market Manual Conventions	viii
1 Introduction	1
1.1 Purpose.....	1
1.2 Scope	1
1.3 Contact Information	3
2 Outage Management Overview	4
2.1 Market Participant Planned Outages	5
2.2 IESO Planned IT Outages.....	6
2.3 Confidentiality	6
3 Outage Management Information	9
3.1 Criticality Levels of Equipment.....	10
3.2 Priority Codes	11
3.2.1 Determining Outage Priority	14
3.3 Purpose Codes	16
3.4 Constraint Codes	19
3.5 Low-Impact Attributes	21
3.5.1 Submission Timelines	22
3.6 Mapping Purpose, Constraint and Priority Codes	22
3.7 Timelines.....	24
3.7.1 General Requirements	24
3.7.2 Quarterly Advance Approval Process.....	26
3.7.3 Weekly Advance Approval Process	29
3.7.4 Three-Day Advance Approval Process	30
3.7.5 One-Day Advance Approval Process.....	32
3.7.6 Auto Advance Approvals	33
3.7.7 Final Approval in Advance	35

3.7.8 Submission Deadlines	36
4 Outage Management Procedures	38
4.1 Facility Registration	38
4.2 Outage Coordination	38
4.2.1 Undesirable Situations	39
4.2.2 Outage Planning Guidelines	39
4.2.3 Conflicting Constraint Codes	42
4.2.4 Conflict Checking	44
4.2.5 IESO Reports	46
4.3 Outage Coordination for Capacity Exports	46
4.3.1 Capacity Seller Requirement to Coordinate with Transmitters Prior to IESO Involvement	47
4.3.2 Capacity Seller Requirement to Coordinate with Transmitters Requiring IESO Involvement	49
4.4 Outage Coordination for Generator-Backed Capacity Import Resources	50
4.5 Outage Submission	51
4.6 Outage Assessment	54
4.6.1 Market Participant Updates	55
4.6.2 Outage Assessment Outcomes	56
4.7 Outage Implementation	61
4.7.1 Planned and Forced Extensions	62
4.7.2 Recall	62
4.7.3 Suspension of Non-Urgent Maintenance or Switching	63
4.8 Outage Completion	63
4.9 Outage Compensation	64
4.9.1 Example A: Market Participant NOT Entitled to Compensation	65
4.9.2 Example B: Market participant Entitled to Compensation	65
4.9.3 Example C: Market Participant Entitled to Compensation	66
5 Outage Reporting Requirements	68
5.1 Generation Facilities and Electricity Storage Facilities	68
5.1.1 Deratings	69
5.1.2 Tests	70
5.1.3 Commissioning Facilities	74
5.1.4 Segregated Mode of Operation	76
5.2 Loads	79
5.2.1 Dispatchable Loads	79
5.2.2 Connected Wholesale Customers	80

5.2.3 Distributors and Transmitters80

5.2.4 Outages and Non-Performance Event Management for Capacity Auction
Resources81

5.3 All Market Participants.....83

5.3.1 Monitoring and Control Equipment83

5.3.2 System Tests.....83

5.3.3 Testing of Ancillary Services.....85

5.3.4 Testing Operating Reserve Providers86

5.3.5 Hold-offs88

5.3.6 New and Replacement Facilities88

6 Replacement Energy to Support Planned Outages.....90

7 Dispute Resolution.....95

Appendix A: Outage Reporting Requirements.....97

Appendix B: Equipment Classes and Applicable Constraint Codes...105

**Appendix C: Criteria for One-Day Advance Approval, Auto AA and FAA
.....108**

List of Acronyms117

References119

List of Figures

<u>Figure 3-1: Quarterly Advance Approval Timeline</u>	<u>26</u>
<u>Figure 3-2: Criteria for 'At Risk' Outage Retaining Original Priority</u>	<u>27</u>
<u>Figure 3-3: 'At Risk' Outage Reassessment – Example A</u>	<u>28</u>
<u>Figure 3-4: 'At Risk' Outage Reassessment – Example B</u>	<u>28</u>
<u>Figure 3-5: Weekly Advance Approval Timeline.....</u>	<u>30</u>
<u>Figure 3-6: Three-Day Advance Approval Timeline</u>	<u>31</u>
<u>Figure 3-7: One-Day Advance Approval Timeline</u>	<u>33</u>
<u>Figure 4-1: Partial Equipment Outage Example.....</u>	<u>45</u>
<u>Figure 4-2: Compensation Eligibility – Example A</u>	<u>65</u>
<u>Figure 4-3: Compensation Eligibility – Example B</u>	<u>66</u>
<u>Figure 4-4: Compensation Eligibility – Example C</u>	<u>66</u>
<u>Figure 5-1: Submitting Test Request during Outage</u>	<u>71</u>
<u>Figure 6-1: Purchase of Replacement Energy – Requirements and Confirmation Timeline</u>	<u>92</u>
<u>Figure 6-2: Outage Submission Timeline Example</u>	<u>93</u>
<u>Figure 6-3: Precedence of Outages Based on Purchase of Replacement Energy.....</u>	<u>94</u>

List of Tables

Table 3-1: Criticality Levels of Equipment	10
Table 3-2: Priority Codes.....	12
Table 3-3: Outage Approval Example	15
Table 3-4: Outage Rejection Example.....	15
Table 3-5: Purpose Codes.....	17
Table 3-6: Constraint Codes.....	20
Table 3-7: Mapping of Purpose, Constraint and Priority Codes	22
Table 3-8: Advance Approval Timelines and Eligibility.....	25
Table 3-9: One-Day Advance Approval Eligibility Example	32
Table 3-10: Auto Advance Approval Example	34
Table 3-11: Final Approval in Advance Example	35
Table 3-12: Outage Submission and IESO Review Timeline	36
Table 4-1: Transmission Groupings	40
Table 4-2: Seasonal Time Frame	41
Table 4-3: Sample Outage Planning Guideline	42
Table 4-4: Outage Request Constraint Code Conflicts	43
Table 4-5: Constraint Code Conflict Example	44
Table 4-6: Criteria for Conflict Rationale Acceptance	45
Table 4-7: Applicable Codes for Generator-backed Capacity Import Resources	51
Table 4-8: Information Requirement during Outage Submission	51
Table 4-9: Market Participant Outage Request Updates.....	55
Table 4-10: Possible Next Steps after Providing Advance Approval	56
Table 4-11: Possible Next Steps after Negotiate to Reschedule	61
Table 4-12: Communication with the IESO Control Room	62
Table 4-13: Outage End Time Adjustment.....	63
Table 5-1: Example Codes for Electricity Storage Resources when Unable to Withdraw	68
Table 5-2: Example Codes when Submitting Planned Derate Requests	70
Table 5-3: Offer Price Test Example	72
Table 5-4: Operating Reserve Market Participation Example	73
Table 5-5: Example Codes when Submitting Planned Testing Requests.....	74
Table 5-6: Example Codes for Commissioning Generation Facilities and Commissioning Electricity Storage Facilities	76
Table 5-7: Example Codes When Requesting Planned Segregated Mode of Operation.....	79

<u>Table 5-8: Example Codes for Planned Outages to Dispatchable Loads</u>	<u>80</u>
<u>Table 5-9: Applicable Codes for Wholesale Customers</u>	<u>80</u>
<u>Table 5-10: Example Codes for Distributors and Transmitters</u>	<u>81</u>
<u>Table 5-11: Applicable Codes for Demand Response Resources.....</u>	<u>82</u>
<u>Table 5-12: Example Codes for Planned Outages to Monitoring and Control Equipment</u>	<u>83</u>
<u>Table 5-13: Example Codes When Submitting Planned System Test Requests.....</u>	<u>85</u>
<u>Table 5-14: Implementing and Assessing Reserve Tests.....</u>	<u>87</u>
<u>Table 5-15: Example Codes When Submitting Planned Hold-off Requests</u>	<u>88</u>
<u>Table 5-16: Example Codes When Requesting Planned Outages to New and Replacement Resources</u>	<u>89</u>
<u>Table 6-1: Replacement Energy Purchase</u>	<u>93</u>
<u>Table B-1: Applicable Constraint Code per Equipment Class</u>	<u>105</u>
<u>Table C-1: Criteria for One-Day Advance Approval, Auto AA and FAA</u>	<u>108</u>

Table of Changes

Reference (Section and Paragraph)	Description of Change
Sections 3.4 (new) and throughout	Updated to include outage provisions for <i>generator-backed capacity import resources.</i>

Market Manuals

~~The *market* Market manuals consolidate the market procedures set out procedural and associated forms, standards, and policies that define certain elements relating administrative details with respect to the operation of the IESO administered markets. Market procedures provide more detailed descriptions of the *market rule* requirements for various activities than is specified in the *market rules*. Where there is a discrepancy conflict between the requirements described in a document within a market manual and or appended document, and those within the market rules, the market rules shall prevail. Standards and policies appended to, or referenced in, these procedures provide a supporting framework.~~

Market Procedures

~~The “System Operations Manual” is Series 7 of the *market manuals*, where this document forms “Part 7.3: Outage Management”. Conventions~~

This *market manual* uses the following conventions:

- the word 'shall' denotes a mandatory requirement;
- references to *market rule* sections and sub-sections may be abbreviated in accordance with the following representative format: ‘MR Ch.1 ss.1.1-1.2’ (i.e. *market rules*, Chapter 1, sections 1.1 to 1.2).
- references to *market manual* sections and sub-sections may be abbreviated in accordance with the following representative format: ‘MM 1.5 ss.1.1-1.2’ (i.e. *market manual* 1.5, sections 1.1 to 1.2).
- internal references to sections and sub-sections within this manual take the representative format: ‘sections 1.1 – 1.2’
- terms and acronyms used in this *market manual* in its appended documents that are italicized have the meanings ascribed thereto in **MR Ch.11**;

- data fields are identified in all capitals; and
- references to "Day 0" mean the current day, references to "Day 1" mean the day immediately after the current day, references to "Day 2" mean the day two days after the current day, and so on.

– End of Section –

1 Introduction

1.1 Purpose

This ~~document~~*market manual* is provided for *market participants* as a guide to *outage* management for *facilities* and equipment connected to the *IESO-controlled grid*, or which may affect the operation of the *IESO-controlled grid*. This includes *outages* to *transmission facilities**systems* defined as constituting elements of the *IESO-controlled grid* under the *market rules* and various *operating agreements* between the *IESO* and *market participants*.

~~1.21.1~~ Scope

This ~~procedure~~*market manual* is intended to provide *market participants* with a summary of the steps and interfaces involved in the *outage* management process. ~~The procedural workflows and steps described~~The procedures contained in this document serve as a roadmap for *generation facilities*, *transmitters*, *distributors*, *electricity storage facilities*, and *wholesale customers* that participate in the *IESO-administered markets*, and reflect the requirements set out in the *market rules* and applicable *IESO* policies and standards, as well as standards established by the *North American Electric Reliability Corporation (NERC)* and criteria established by the *Northeast Power Coordinating Council (NPCC)*.

1.2 Scope

This *market manual* supplements the following *market rules*:

- MR Ch.1 s.14: Exemptions
- MR Ch.3 s.2: Establishment and Staffing of Market Assessment Unit
- MR Ch.5 s.5.2: Confidentiality
- MR Ch.3 s.6.6.10
- MR Ch.4 s.7.7: Reliability, Maintenance and Repair of Monitoring and Control Equipment
- MR Ch.4 App.4.2: Requirements for Generation and Electricity Storage Facilities Connected to the IESO-Controlled Grid
- MR Ch.5 s.2.5.2
- MR Ch.5 s.3.2.1
- MR Ch.5 s.3.3: Reliability-Related Information

- [MR.Ch.5 s.3.4: Obligations of Transmitters](#)
- [MR.Ch.5 s.3.5: Obligations of Wholesale Customers](#)
- [MR.Ch.5 s.3.6: Obligations of Generators \(Embedded and Non-embedded\)](#)
- [MR.Ch.5 s.3.7: Obligations of Distributors](#)
- [MR.Ch.5 s.3.8: Obligations of Electricity Storage Participants \(Embedded and Non-embedded\)](#)
- [MR Ch.5 s.4.9: Auditing and Testing of Ancillary Services](#)
- [MR Ch.5 s.4.10: Consequences of Failure to Pass a Test](#)
- [MR Ch.5 s.6.1: Outage Coordination – Introduction](#)
- [MR Ch.5 s.6.2: Outage Planning](#)
- [MR Ch.5 s.6.3: Outage Scheduling with the IESO](#)
- [MR Ch.5 s.6.4: Submission of Outage Schedules and IESO Approval of Outage Schedules](#)
- [MR Ch.5 s.6.4A: Return of Equipment or Facilities to Service](#)
- [MR Ch.5 s.6.5.2](#)
- [MR Ch.5 s.6.6: Tests](#)
- [MR Ch.5 s.6.7: Compensation](#)
- [MR Ch.5 s.7.1: Forecasts Prepared by the IESO](#)
- [MR Ch.5 s.7.3: Advance Assessments of System Reliability](#)
- [MR Ch.5 s.7.7.7: Advisory Notices](#)
- [MR Ch.5 s.10.2.3](#)
- [MR Ch.7 s.2.2: Facility and Associated Resources Registration](#)
- [MR Ch.7 s.2.3.2](#)
- [MR Ch.7 s.3.3.8: Obligation to Revise Dispatch Data](#)
- [MR Ch.7 s.3.5.6](#)
- [MR Ch.7 s.19.4: Energy Market Participation for Hourly Demand Response Resources](#)
- [MR Ch.7 s.19.5: Energy Market Participation for Capacity Dispatchable Load Resources](#)
- [MR Ch.7 s.19.7: Energy Market Participation for Capacity Generation Resources](#)

- [MR Ch.7 s.19.9.5: Outage Notification Requirements for System-Backed Capacity Import Resources](#)
- [MR Ch.7 s.19.9B: Energy Market Participation for Generator-Backed Capacity Import Resources](#)
- [MR Ch.7 s.19.11: Energy Market Participation for Capacity Storage Resources](#)
- [MR Ch.7 App.7.7 s.1.3: Scheduling & Scheduling Approval](#)

1.3 Contact Information

Changes to this *market manual* are managed via the *IESO* Change Management process. Stakeholders are encouraged to participate in the evolution of this *market manual* via this process.

To contact the *IESO*, you can email *IESO* Customer Relations at customer.relations@IESO.ca or use telephone or mail. Telephone numbers and the mailing address can be found on the *IESO* website (<http://www.IESO.ca/corporate-IESO/contact>). *IESO* Customer Relations staff will respond as soon as possible.

– End of Section –

2 Outage Management Overview

(MR Ch.5 ss.6.1 – 6.2; MM 7.4 s.2.3)

Outage state – The *IESO* considers a piece of equipment to be in an *outage* state when it is–:

- removed from service–;
- in a state other than its normal state–;
- unavailable for connection to the system–;
- temporarily derated–;
- restricted in use–; or
- reduced in performance.

De-staffing and auxiliary equipment – This includes de-staffing of a *generation unit* or an *electricity storage unit* during a period when *market participants* do not expect the unit to be scheduled to provide *energy* or *operating reserve*. Auxiliary equipment is also considered to be in an *outage* state when it is not available for use.

~~*Outage management, based upon the set of permissions and requirements specified in the market rules, comprises the following aspects:*~~

- ~~• *Coordination and submission of outage requests by market participants,*~~
- ~~• *Assessment of outage requests by the IESO,*~~
- ~~• *Identification of reliability issues associated with outages, leading to actions including rejection, revocation, and at risk declarations of the outage request, and recall of the equipment on outage by the IESO,*~~
- ~~• *Compliance obligations, and*~~
- ~~• *Outage compensation in the event of revocation or recall.*~~

~~In support of these aspects, this procedure details the conditions, actions and timelines required for outage management by market participants. The procedure is based on obligations expressed in the market rules, as well as standards established by the North American Electric Reliability Council (NERC) and criteria established by the Northeast Power Coordinating Council (NPCC).~~

~~1.1 Roles and Responsibilities~~

~~The following table outlines the responsibilities of the groups involved in the outage management process:~~

Table 1-1: Roles and Responsibilities

Group	Responsibility
<i>Market participants that meet the IESO's outage reporting requirements</i>	<ul style="list-style-type: none"> ● Coordinate and submit outages using IESO reports and recommendations, ● Submit requests to implement outages to their facilities or equipment within the required timeframe to the IESO, ● Request final approval prior to start of the outage, ● Confirm the start of the outage, ● Confirm the completion of outage, ● Request permission to return equipment to service, ● Confirm the restoration of equipment to normal state with the IESO, and ● Register new equipment information and update information for existing equipment via Online IESO¹.
<i>IESO</i>	<ul style="list-style-type: none"> ● Assess outage requests for potential impact to reliability and/or operability² of the IESO-controlled grid, ● Provide advance and final approval for outage requests, ● Reject an outage request, and revoke or recall previously approved outages for reliability reasons, ● Coordinate outages and tests if required, and ● Grant permission for equipment to return to service.

2.1 Market Participant Planned Outages

(MR Ch.5 s.6.4.3)

Generator backed capacity import resources – Pursuant to **MR Ch.5 s.6.4.3**, *generator-backed capacity import resources* are required to request permission and receive approval for *planned outages* from the IESO when that *outage* impacts the *resource's* ability to provide its *capacity obligation*.

Scope of coordination – *Market participants* with equipment that affects the operation of the *IESO-controlled grid* may not remove equipment or *facilities* from service except in accordance with the rules for *outage* coordination contained in **MR Ch.5 s.6.4.3** and this *market manual*.

Control Room Operations Window – The *IESO's outage* management system uses the Control Room Operations Window (CROW) *outage* coordination and

¹ Online IESO is an online tool for *market participants* to submit data to the IESO.

² For the purposes of this document, “operability” ensures the flexibility to safely operate the *IESO-controlled grid* considering, for instance, the risk of unplanned system or generation changes, and variable generation behaviour.

scheduling system. *Market participants* are required to submit information that provides the *IESO* with a better understanding of the priority, scope and impact of the *outage* request as described in section 3.

Processes for advanced approval – *Market participants* must submit their *planned outages* into one of four *advance approval* processes (quarterly, weekly, three-day or one-day) in order to receive *advance approval*. Each process has a unique set of eligibility criteria and submission/approval deadlines, which are further described in section 3.7.

Processes for notifications and late requests – Forced, urgent, information, and opportunity *outages* are *outages* that *market participants* are unable to submit in accordance with the submission requirements for *planned outages*. However, *market participants* must still submit these types of *outages* to the *IESO* as either a notification pursuant to **MR Ch.5 s.6.3.4** or a late request for *advance approval* pursuant to **MR Ch.5 s.6.4.6** as described in section 3.2.

2.2 IESO Planned IT Outages

(MR Ch.5 ss.3.3 and 7.7.7)

IESO communication – *Market participants* are normally notified about planned Information Technology (IT) *outages* to market-facing tools and applications through weekly bulletin emails. Details ~~for~~^{of} all planned IT *outages* are also posted on the *IESO's* IESO Planned IT Outages website. For unforeseen IT *outages*, *market participants* are notified via an advisory notice and/or via a message through the Market Participant Interface.

~~For unforeseen IT *outages*, *market participants* are notified via an Advisory Notice and/or via a message through the Market Participant Interface.~~

2.3 Confidentiality

~~Under the *market rules*, the *IESO* is required to *publish planned outage* information while respecting the confidentiality of *market participants*. As a result, *outage* requests submitted by *market participants* may be classified as confidential, and protected appropriately.~~

~~In addition, the~~ (MR Ch.3 s.5.2; MR Ch.5 s.6.5.2)

Publication – The Adequacy Reports will aggregate *outage* information to protect the confidentiality of *market participants*. All planned *transmission system outages* will be published for information. This may include transmission elements that are not owned by a *transmitter*.

Exchange of information – *Outage* information will only be exchanged with ~~Reliability Coordinators~~ reliability coordinators (RCs) and ~~Balancing~~

Authoritiesbalancing authorities (BAs) who are signatories to the *NERC confidentiality agreement* or who are otherwise legally bound to withhold and keep confidential *outage* information from any person competing with a *market participant* who provided the information.

Third party viewership – *Market participants* may choose to share *outage* information with other *market participants* by granting third party viewership of their equipment via Online IESO. A single *outage* request may contain **both**, equipment **both** with and without third party viewership access. In such cases, third party viewers will only see the equipment to which they have access.

– End of Section –

~~1.31.1 Contact Information~~

~~Changes to this public *market manual* are managed via the IESO Change Management process. Stakeholders are encouraged to participate in the evolution of this *market manual* via this process.~~

~~To contact the IESO, you can email IESO Customer Relations at customer.relations@ieso.ca or use telephone or mail. Customer Relations staff will respond as soon as possible.~~

~~—End of Section—~~

23 Outage Management Overview Information

~~Market participants are required to request permission and receive approval for planned outages from the IESO in order to ensure that equipment outages do not impact the reliability and/or operability of the IESO-controlled grid. Generator-backed capacity import resources are required to request permission and receive approval for planned outages from the IESO when that outage impacts the resource's ability to provide its capacity obligation. Market participants with equipment that affects the operation of the IESO-controlled grid may not remove equipment or facilities from service except in accordance with the rules for Outage Coordination contained in Market Rule Chapter 5, Section 6.4.3 (MR Ch. 5, Sec. 6.4.3) and this market manual.~~

~~The IESO's outage management system uses the the Control Room Operations Window (CROW) outage coordination and scheduling system. Market participants are required to submit information that provides the IESO with a better understanding of the priority, scope and impact of the outage request as described in Sections 2.1 to 2.5.~~

~~Market participants must submit their planned outages into one of four advance approval processes in order to receive advance approval. Each process has a unique set of eligibility criteria and submission/approval deadlines further described in Section 2.7.~~

~~Forced, urgent, information and opportunity outages are outages that market participants are unable to submit in accordance with the submission requirements for planned outages, however these types of outages must still be submitted to the IESO as either a notification or a late request for advance approval as described in Section 2.2.~~

This section covers the following *outage* management information:

- Criticality Levels of Equipment
- Priority Codes
- Purpose Codes
- Constraint Codes
- Low-Impact Attributes
- Mapping Purpose, Constraint and Priority Codes
- Timelines

3.1 Criticality Levels of Equipment

(MR Ch.5 s.6.4)

Criticality – The level of equipment criticality dictates the *advance approval* timeframe within which a planned *outage* request must be submitted (see under MR Ch.5 s.6.4 (refer to Table 23-1)). For example, *planned outages* to critical equipment must be submitted at least 17 days prior to the start of the coverage period (under the *Weekly Advance Approval* process), whereas *planned outages* to low-impact equipment must be submitted two days prior to the scheduled date of the *outage* (under the ~~1-Day~~ *One-day Advance Approval* process). Section 2.7 Section 3.7 describes *advance approval* processes and eligible equipment in further detail.

Online IESO – The *IESO* notifies *market participants* of equipment criticality levels via Online IESO, upon completion of *facility* assessment. When submitting *outage* requests, *market participants* are required to identify the impacted equipment and the *outage* management system will auto-populate the criticality level.

Table ~~2-1~~3-1: Criticality Levels of Equipment

Criticality Level	Description	Examples	Advance Approval Submission Timeline
Critical Equipment ³	Equipment that has a material impact on the <i>reliability</i> and/or operability of the <i>IESO-controlled grid</i> or the <i>interconnection</i> when removed from service or restricted.	Equipment that impact power system stability limits	<ul style="list-style-type: none"> • Must be submitted for Weekly Advance Approval <i>weekly advance approval</i> • May be submitted for Quarterly Advance <i>Quarterly Advance</i>

³ Refer to ~~Section 2~~ section 3.7.5 for submission timelines for *outage* requests to critical and non-critical equipment with low-impact attributes.

Criticality Level	Description	Examples	Advance Approval Submission Timeline
			Approval quarterly advance approval
Non-critical Equipment ³	Equipment that does not typically have a material impact on the <i>reliability</i> and/or operability of the <i>IESO-controlled grid</i> or the <i>interconnection</i> when removed from service or restricted.	<ul style="list-style-type: none"> Equipment in <i>local areas</i> <i>Generation facilities</i> or <i>electricity storage facilities</i> 	<ul style="list-style-type: none"> Must be submitted for 3- Day Advance Approval <u>three-day advance approval</u> May be submitted for Quarterly <u>quarterly advance approval</u> or Weekly Advance Approval <u>weekly advance approval</u>
Low-impact Equipment	Equipment that has little to no impact on the <i>reliability</i> and/or operability of the <i>IESO-controlled grid</i> or the <i>interconnection</i> when removed from service or restricted.	<ul style="list-style-type: none"> Loads Duplicated protection relays 	<ul style="list-style-type: none"> Must be submitted for 1- Day Advance Approval <u>one-day advance approval</u> May be submitted for Quarterly, Weekly Advance Approval <u>three-day, quarterly, weekly advance approval</u>

3.2 Priority Codes

(MR Ch.5 ss.6.2.2K, 6.2.2L, 6.3.4 and 6.4.6)

Coding – Priority codes identify the priority of the *outage* request. ~~Refer to Table 2-2: Priority Codes below, as described in Table 3-2.~~ The *IESO* uses this information to determine the level of urgency to implement the *outage* and to prioritize competing *outage* requests. ~~For example, an urgent outage request gets a higher priority compared to an opportunity outage request.~~

~~Refer to Section 2.2.1~~ Refer to section 3.2.1 for more information on how the *IESO* determines *outage* priority.

Market participants are required to use one of the following ~~Priority Codes~~ priority codes when submitting their *outage* request.

Note: Priority ~~Codes~~ codes cannot be changed by *market participants* once they have been submitted.

Table 2-2.3-2: Priority Codes

Priority Codes	Description	Examples	Obligation to Notify IESO
Forced	Non-discretionary <i>outages</i> on equipment that has been automatically or manually removed from service for equipment protection, public safety, environmental concerns or regulatory requirements are classified as <i>forced outages</i> . Such <i>outages</i> have little to no timing flexibility and have precedence over all Priority Codes .	Transformer forced out-of-service due to equipment failure	<i>Market participants</i> are required, as far in advance as possible, to promptly notify the <i>IESO</i> of any <i>forced outage</i> (MR Ch. 5, Sec. s.6.3.4).
Urgent	Non-discretionary <i>outages</i> on equipment that must be manually removed from service for equipment protection, public safety, environmental concerns or regulatory requirements are classified as <i>urgent outages</i> .	SF6 breaker low gas alarm that requires a breaker <i>outage</i> for gas top-up within a limited timeframe	<i>Market participants</i> are required to coordinate <i>outage</i> timing with the <i>IESO</i> , where possible, to occur at a date and time that satisfies the <i>market participant's</i> need and minimizes the impact to the <i>IESO-controlled grid</i> .
Planned	Discretionary <i>outage</i> requests that are scheduled to perform preventive maintenance, repairs, inspections, de-staffing and testing for <i>facilities/equipment</i> are classified as <i>planned outages</i> .	<ul style="list-style-type: none"> • <i>Generation facility</i> or <i>electricity storage facility</i> scheduled maintenance • Breaker trip coil test 	<i>Market participants</i> must adhere to submission deadlines explained in Section 2.7 of this manual (MR Ch. 5, Sec. ss.6.2.2K and 6.2.2L).

Priority Codes	Description	Examples	Obligation to Notify IESO
Opportunity	<p>In cases where <i>market participants</i> are presented with an unexpected opportunity to accomplish work that was not previously planned, they may submit an <i>outage</i> request with the opportunity Priority Code. <u>Opportunity priority code</u>.</p>	<ul style="list-style-type: none"> • Additional testing is required to expedite the completion of an in-progress <i>forced outage</i> to a <i>generation facility</i> or <i>electricity storage facility</i>. • <u>An opportunity to perform maintenance to a <i>facility</i> that is made grid-incapable by another <i>outage</i></u>. • <u>Requests to operate in <i>segregated mode of operation</i></u> 	<p>The <i>IESO</i> is not obligated to consider such submissions, but may do so where the opportunity presents low to negligible risk to the <i>reliability</i> and/or operability of the <i>IESO-controlled grid</i> and or to the <i>IESO</i>. (MR Ch.-5, Sec. s.6.4.6).</p>
Information	<p><i>Outages</i> that are exempt from submission requirements outlined in Appendix B, Appendix A, but are submitted for informational purposes only, are classified as information <i>outages</i>.</p>	<ul style="list-style-type: none"> • Generation <i>facility resource</i> or <i>electricity storage facility resource</i> unavailable for condense • Switch on manual operation only 	<p>No obligation. <i>Market participants</i> may, as far in advance as possible, notify the <i>IESO</i> of any information <i>outage</i>, using their <i>outage</i> submission tools.</p>
Force Extended	<p>This code is not available to <i>market participants</i> when submitting <i>outage</i> requests. However, if the end time of a planned, opportunity, or information <i>outage</i> requests get extended their Priority Code<u>priority code</u> will be updated to forced extended.</p>	<p>Adverse weather conditions delay the completion of a scheduled <i>outage</i></p>	<p><i>Market participants</i> are required to notify the <i>IESO</i> of any forced extension as far in advance as possible, using their <i>outage</i> submission tools and by telephoning the <i>IESO</i>.</p>

3.2.1 Determining Outage Priority

(MR Ch.5 s.6.4.2)

IESO determination – The *IESO* determines priority of *outages* in order to approve, reject, revoke and recall *outages* in a consistent and uniform manner.

Determination criteria – *Outage* priority for approval ~~(as per MR Ch. 5, Sec. 6.4.2)~~ is based on the criteria listed ~~below~~: in section 3.2.2.1.

3.2.1.1 Criteria 1: Priority Code

The ~~Priority Code~~ priority code of an *outage* request is the primary determinant of *outage* priority. The order of precedence is as follows:

1. Forced
2. Urgent
3. Planned
4. Opportunity

For example, when approving *outages*, an urgent *outage* request gets priority over a planned or opportunity *outage* request.

3.2.1.2 Criteria 2: Advance approval timeframe

Within *planned outages*, the order of precedence is as follows:

1. *Outages* submitted for ~~Quarterly Advance Approval~~ quarterly advance approval
2. *Outages* submitted for ~~Weekly Advance Approval~~ weekly advance approval
3. *Outages* submitted for ~~3-Day Advance Approval~~ three-day advance approval
4. *Outages* submitted for ~~1-Day Advance Approval~~ one-day advance approval

For example, a *planned outage* request submitted for ~~Weekly Advance Approval~~ weekly advance approval gets priority over a *planned outage* request submitted for ~~3-Day Advance Approval~~ three-day advance approval. However, an urgent *outage* request submitted five days ahead of the planned start time gets priority over a *planned outage* request submitted under the ~~Weekly Advance Approval~~ weekly advance approval process.

3.2.1.3 Criteria 3: Priority date

(MR Ch.5 ss.6.4.13 and 6.4.15)

For urgent and opportunity *outages*, the submission date and time determine *outage* priority. The earlier the submission, the higher is the priority of the *outage* request.

For *planned outages* submitted within the same *advance approval* timeframe, the submission date and time determine *outage* priority. ~~For example:~~

Table 3-3: Outage Approval Example

If...	Then...
<p>The following <i>outages</i> are submitted for approval:</p> <p><i>Outage A:</i> Opportunity <i>outage</i> submitted three days ahead of the planned start time</p> <p><i>Outage B:</i> Urgent <i>outage</i> submitted five days ahead of the planned start time</p> <p><i>Outage C:</i> <i>Planned outage</i> submitted for the <i>Weekly Advance Approval</i> process</p> <p><i>Outage D:</i> Opportunity <i>outage</i> submitted five days ahead of the planned start time</p> <p><i>Outage E:</i> <i>Planned outage</i> submitted for the 3<i>Three-Day Advance Approval</i> process</p>	<p><i>Outage</i> priority will be as follows:</p> <ol style="list-style-type: none"> 1. Outage B 2. Outage C 3. Outage E 4. Outage D 5. Outage A

Rejection and revocation – To determine priority when rejecting, revoking *advance approval* or recalling *outages*, the *IESO* shall follow the reverse order of the criteria listed above (**MR Ch. 5, Sec. 6.4.13**). Where an *outage* conflict exists and one or more conflicting *outages* are rejected or revoked, the *IESO* may facilitate communication between the parties. ~~For example:~~

Table 3-4: Outage Rejection Example

If...	Then...
<p>The <i>IESO</i> determines a need to reject the following submitted <i>outage</i> requests:</p> <p>Outage A: Opportunity <i>outage</i> submitted three days ahead of the planned start time</p> <p>Outage B: Urgent <i>outage</i> submitted five days ahead of the planned start time</p> <p>Outage C: <i>Planned outage</i> submitted for the <i>Weekly Advance Approval</i> process</p> <p>Outage D: Opportunity <i>outage</i> submitted five days ahead of the planned start time</p> <p>Outage E: <i>Planned outage</i> submitted for the 3<i>Three-Day Advance Approval</i> process</p>	<p><i>Outages</i> will be rejected in the following order:</p> <ol style="list-style-type: none"> 1. Outage A 2. Outage D 3. Outage E 4. Outage C 5. Outage B

Significant changes – If *market participants* make a significant change to the scope or time window of a previously submitted *outage* request, the *IESO* shall revise the priority date with the time at which such change notice was received by the *IESO*. Changes to the following *outage* request fields are considered to be significant changes:

- Planned Start (if changed to an earlier *outage* period level⁴ start date/time)
- Planned End (if changed to a later *outage* period level⁴ end date/time)
- Equipment Requested (if equipment is added or removed)
- Equipment Description
- Priority Code
- Constraint Information (if change in ~~Constraint Code~~constraint code, value, and/or measure unit)
- Changes to any responses to low-impact questions (~~Refer~~refer to Section 2.5section 3.5 for details)
- Change to the response to the Telemetry Scaling Impact question

~~The revised priority date will then be used to determine the priority for approval. In cases where market participants shorten the duration of a planned outage to remain within the original time window, the priority date associated with the initial submission will still be used to determine priority (MR Ch. 5, Sec. 6.4.15).~~

Shortening max recall time – In cases where *market participants* wish to shorten the max recall time, they must verbally request the *IESO* to retain the original *outage* priority.

-3.3 Purpose Codes

(MR Ch.5 ss.6.2.2K, 6.2.2L, 6.3.4 and 6.4.6)

Coding – Purpose Codes allow *market participants* to indicate the reason for the *outage* request. ~~Refer~~ (refer to ~~Table below.~~Table 3-5). This information is used by the *IESO* to determine the impact and purpose of the *outage* request. For example, an *outage* request submitted for a safety concern informs the *IESO* of the *market participant's* urgent need compared to an *outage* request to conduct maintenance/repair testing which can be planned in advance.

Requirement to select – *Market participants* are required to select one of the following Purpose Codes when submitting their *outage* request and input a description of the *outage's* purpose in the *outage* management system.

⁴ *Outage* period level date/time refers to the date/times of the individual *outage* periods on the Details tab, not limited to the overall *outage* date/times.

Note: Availability – Selection of Purpose Codes is based on the Priority Code. For example, 'Equipment Concern' code is available only if the *market participant* is submitting a *forced outage* or urgent *outage*. Similarly, the 'Repair' code is available only for *planned outages*. Refer to [Section 2.6 section 3.6](#) for a mapping of Purpose and Priority Codes.

Table 2-3-3-5: Purpose Codes

Purpose Code	Description	Example
Maintenance Repair	<i>Outages</i> implemented to facilitate routine equipment maintenance and repair.	Annual transformer maintenance
Replacement	<i>Outages</i> implemented to replace aging or faulty equipment/ <i>facilities</i> . In such cases, <i>market participants</i> must ensure the replacement is registered with the <i>IESO</i> as per Market Manual 1.5: Market Registration Procedures-MM 1.5 . The <i>outage</i> to replace the equipment/ <i>facility</i> is typically followed by a need to carry out a commissioning <i>outage</i> as explained below.	Breaker replacement
Commissioning	<i>Outages</i> implemented to test new or modified equipment/ <i>facilities</i> being connected to the <i>IESO-controlled grid</i> for the first time.	Commissioning of new <i>generation facility</i> or <i>electricity storage facility</i>
Testing	<i>Outages</i> implemented to facilitate testing of equipment/ <i>facilities</i> not considered to be commissioning tests or activities.	<i>Generation facility minimum load loading point</i> testing
Equipment/Safety/Regulatory/Environmental Concerns	<i>Outages</i> implemented for non-discretionary purposes such as public safety, equipment protection, environmental concerns or regulatory requirements.	<i>Generation facility derate</i> due to restrictive <i>forebay</i> operating ranges
Favourable (Generation/ Electricity Storage/ Transmission) Outage Condition/Favourable Adequacy Margin/ Expedite Return to Service	<i>Outages</i> having low to negligible risk to the <i>reliability</i> of the <i>IESO-controlled grid</i> and are implemented to accomplish work that would have otherwise been unable to proceed. Note: <i>Market participants</i> may select this code, however the <i>IESO</i> will assess and determine the <i>outage's</i> impact on the <i>IESO-controlled grid</i> .	Transformer feeder <i>outage</i> during existing <i>outage</i> to connecting circuit

Purpose Code	Description	Example
Manually/Automatically Removed From Service	Unforeseen <i>outages</i> that result in manual or automatic removal of equipment/ <i>facilities</i> from service.	Unit trip from neutral overcurrent
Failed to Synch	Unforeseen <i>outages</i> resulting from a failure to synchronize <i>generation units</i> or <i>electricity storage equipment/facilities units</i> to the <i>IESO-controlled grid</i> .	Unit breaker failed to synch
<i>Segregated Mode of Operation</i>	<i>Outage</i> to indicate generation or transmission equipment/ <i>facilities</i> being disconnected from the <i>IESO-controlled grid</i> and connected to an external system, <i>i.e.g.</i> Quebec.	<i>Generation facility</i> connected to Quebec
Cyber Asset Change/ Relay Setting Change	<i>Outages</i> to indicate hardware/software changes for RTUs, gateways, routers, protection relays etc. intended to separate such requests from other general <i>planned outages</i> .	Software changes for RTU
Transmission Equipment Derating	<i>Outages</i> to indicate that a piece of transmission equipment is operating at a reduced equipment rating.	Transformer derating for degraded cooling
Switching	Short duration <i>outage</i> required to support the removal of equipment for a separate <i>outage</i> request.	Circuit terminals required for 15 min minutes to switch circuit out of service
Telco Third Party Threat	Telecommunication <i>outages</i> requested of Hydro One by a third party telecom provider	Third party company to perform protection and control maintenance of Access Multiplexer

Purpose Code	Description	Example
Self-Bottling	<p><i>Outages</i> implemented to indicate that a <i>variable generation resource</i> is operating to a reduced maximum generation output due to constraints resulting from transmission element <i>outages</i> within the <i>resource's facility</i>.</p> <p>Note: -This is to ensure that the centralized forecast predicts output of the station proportionate to their available capacity but capped at a derated maximum, rather than proportionate to their derated maximum as would be the case with a normal derate <i>outage</i> request.</p>	100 MVA <i>variable generation resource</i> normally connected to two 50 MVA transformers, but one transformer is out-of-service
Icing	<i>Outages</i> implemented to indicate reduced generation capacity due to icing conditions.	Ice on wind turbines
Other	<i>Market participants</i> may use this Purpose Code for <i>outages</i> being requested for any reason other than those listed above.	<i>Generation facility resource</i> or <i>electricity storage facility resource</i> unavailable for Generation Rejection

3.4 Constraint Codes

(MR Ch.5 ss.6.2.2K, 6.2.2L, 6.3.4 and 6.4.6)

Coding – Constraint **Codes** identify the status of the equipment when the *outage* is under implementation. This information is used to determine the limitations on the equipment to determine the impact of the *outage* request on the *IESO-controlled grid*. For example, an 'In--Service' code indicates the equipment is available and functional, whereas an 'Out--of--Service' code indicates the equipment will be unavailable for the duration of the *outage*.

Appendix C Equipment type – Appendix B lists applicable **Constraint Codes** based on equipment type.

Requirement to select – *Market participants* are required to use one of the following **Constraint Codes** when submitting their *outage* request.

Note: Availability – Selection of **Constraint Codes** is based on the **Priority Code**. For example, INFO and ABNO codes are only available for information *outages*. Refer to **Section 2.6 section 3.6** for a mapping of **Purpose** and **Priority Codes**.

Table 2-4-3-6: Constraint Codes

Constraint Code	Description	Examples
Out of Service (OOS)	Equipment is unavailable and removed from service.	Breaker out-of-service
In Service (IS)	Equipment is available and in-service.	Normally open switch required in-service
Derated To (DRATE)	Equipment cannot operate above a specified capability that is less than its rated capability.	<i>Generation facility resource or electricity storage facility resource derated to 50 MW</i>
Must Run At ⁵ (MUSTRUN)	Equipment can only operate at a specified capability that is less than or equal to its rated capability.	<i>Generation facility resource or electricity storage facility resource must run at 50 MW</i>
Hold Off (HOLDOFF)	Equipment has its reclosing capability blocked.	Circuit hold off
Protection Out of Service (PROT OOS) ⁶	Equipment's primary or back-up protection is unavailable in some capacity.	Circuit's B Protection out-of-service
Breaker Fail Protection Out of Service (BF PROT OOS) ⁶	A breaker's backup protection is unavailable in some capacity.	Breaker Fail Protection for Breaker A out of service
<i>Automatic Voltage Regulation or Power System Stabilizer Out of Service (AVR/PSS OOS)⁶</i>	<i>Generation facility's or, if applicable, electricity storage facility's AVR or PSS is unavailable in some capacity.</i>	<i>Generation facility or electricity storage facility AVR out-of-service</i>
Breaker Trip Coil Test (BTCT)	Breaker is undergoing a protection relay-initiated test operation.	Breaker trip coil test for Breaker A

⁵ While the 'Must Run At' and the 'Derated To' codes represent different limitations, the downstream software process at the IESO's end will consider both values to mean the maximum capability for the duration of the *outage* request.

⁶ *Market participants* are required to input a description of the equipment when using this [Constraint Code constraint code](#).

Constraint Code	Description	Examples
Ancillary Service Out of Service (ASP OOS) ⁶	Equipment's ability to provide a contracted <i>ancillary service</i> is restricted in some capacity.	<i>Generation facilityresource</i> or <i>electricity storage facilityresource</i> unavailable for Black-black start, <i>Regulation regulation</i> or <i>Voltage Control voltage control</i>
Information (INFO)	Equipment has a condition or limitation that does not require approval from <i>IESO</i> .	<ul style="list-style-type: none"> <i>Generation facilityresource</i> unavailable for condense Derated <i>dispatchable loads</i> with a <i>demand response capacity obligation</i>
Available But Not Operating (ABNO)	Mechanism for <i>generation facilities</i> and <i>electricity storage facilities</i> to report they do not expect to participate in the market.	<ul style="list-style-type: none"> <i>Generation facilityresource</i> or <i>electricity storage facilityresource</i> off-peak demand <i>Generation facility or electricity storage facilityunit</i> de-staffing

3.5 ~~Low-impact~~ Impact Attributes

(MR Ch.5 ss.6.2.2K, 6.2.2L, 6.3.4 and 6.4.6)

Requirement to answer – During *outage* request submission, *market participants* are required to answer certain questions to determine if their *outage* contains low-impact attributes, thereby making the equipment eligible for ~~1-Day Advance Approval, Auto Advance Approval and/or Final Approval in Advance~~ (further explained in ~~Section 2.7.5, Section 2.7.6 and Section 2.7.7, one-day advance approval, auto advance approval and/or final approval in advance~~ (further explained in sections 3.7.5, 3.7.6 and 3.7.7, respectively)). Low-impact attributes are used by the *IESO* to further define the scope and impact of the requested equipment.

Additional provisions – Refer to ~~Appendix D~~ Appendix C for a list of attributes and applicability.

For example: ~~Market participants~~ *market participant* submitting an *outage* request for line protection out--of--service, ~~they will~~ need to specify whether

it is only a loss of redundancy. If they answer “Yes”, the equipment is considered to have low-impact attributes.

3.5.1 Submission Timelines

(MR Ch.5 ss.6.2.2K, 6.2.2L, 6.3.4 and 6.4.6)

Timelines – The following are the submission timelines for *outages* on equipment with low-impact attributes:

- ~~Must~~ must be submitted for ~~1-Day Advance Approval~~ one-day advance approval;
- ~~May~~ may be submitted for ~~Quarterly, Weekly~~ quarterly, weekly or ~~3-Day Advance Approval~~ three-day advance approval; and
- ~~May~~ may be eligible for ~~Auto Advance Approval~~ auto advance approval and/or ~~Final Approval~~ final approval in ~~Advance~~ advance

3.6 Mapping Purpose, Constraint and Priority Codes

(MR Ch.5 ss.6.2.2K, 6.2.2L, 6.3.4 and 6.4.6)

Coding – Each ~~Priority Code~~ priority code applies to a set of ~~Purpose~~ purpose and ~~Constraint Codes~~ constraint codes. Table ~~2-5 below~~ 3-7 presents a mapping of all codes.

Table ~~2-5~~ 3-7: Mapping of Purpose, Constraint and Priority Codes

Priority Code	Purpose Codes	Constraint Codes
Planned	• Commissioning	All except INFO and ABNO
	• Cyber Asset Change	
	• Maintenance	
	• Other	
	• Relay Setting Change	
	• Repair	
	• Replacement	
	• <i>Segregated Mode of Operation</i>	
	• Switching	
	• Telco Third Party Threat	
	• Testing	
• Self- Bottling	DRATE	

Priority Code	Purpose Codes	Constraint Codes
Urgent	<ul style="list-style-type: none"> • Environmental Concerns • Equipment Concerns • Other • Regulatory Concerns • Safety Concerns • Switching • Telco Third Party Threat 	All except INFO and ABNO
	<ul style="list-style-type: none"> • <u>Wind Turbine Icing Event</u> • Self-Bottling 	DRATE
Opportunity	<ul style="list-style-type: none"> • Commissioning • Expedite Return to Service • Favourable Adequacy Margin • Favourable Generation <i>Outage</i>-/Electricity Storage Condition • Favourable Transmission <i>Outage</i> Condition • Other • <i>Segregated Mode of Operation</i> • Switching • Testing 	All except INFO and ABNO
	<ul style="list-style-type: none"> • Self-Bottling 	DRATE
Information	<ul style="list-style-type: none"> • Other • Transmission Equipment Derating 	<ul style="list-style-type: none"> • INFO • ABNO
Forced	<ul style="list-style-type: none"> • Automatically Removed from<u>From</u> Service • Environmental Concerns • Equipment Concerns • Failed to Synch • Manually Removed from<u>From</u> Service • Other • Regulatory Concerns • Safety Concerns 	All except INFO and ABNO
	<ul style="list-style-type: none"> • <u>Wind Turbine Icing Event</u> • Self-Bottling 	DRATE

3.7 Timelines

3.7.1 General Requirements

(MR Ch.5 ss.6.2.2K, 6.3.4 and 6.4.6)

Time frames – ~~Market participants may request Quarterly, Weekly, 3-Day quarterly, weekly, three-day or 1-Day Advance Approval one-day advance approval~~ for their *planned outages* (MR Ch.5, Sec. ~~s.6.2.2K~~). This section explains the submission and assessment periods for each *advance approval* timeframe. Eligibility for *advance approval* is determined by equipment criticality, as explained in ~~Section 2.1, section 3.1~~.

Study and coverage periods – Each *advance approval* process is associated with distinct submission, study and coverage periods. For the purposes of *outage* submission guidelines described in this document:

- **“Study period”** refers to the period when the *IESO* assesses *planned outage* requests submitted for the associated *advance approval* process. The *IESO* will notify *market participants* of its assessment by the end of the study period.
- **“Coverage period”** refers to the implementation period for *outages* that receive *advance approval* within the associated study period.

Submission prior to relevant study period – *Market participants* must submit *outage* requests before the start of the associated study period, in order to receive *advance approval* for implementation during the associated coverage period.

Forced outages – *Market participants* must submit *forced outage* notifications when they occur and these will be addressed by the *IESO* immediately.

Urgent requests – *Market participants* may submit urgent *outage* requests at any time. The *IESO* will study such requests as soon as possible.

Market participants may submit opportunity *outage* requests at any time. Such requests are considered late *planned outage* requests. The *IESO* is not obligated to consider such submissions, but may do so where the opportunity presents ~~low to negligible risk to the reliability and/or operability of the IESO-controlled grid and or to the IESO~~ (MR Ch.5, Sec. ~~(MR Ch.5 s.6.4.6)~~).

Information outages – *Market participants* may submit information *outage* requests at any time. The *IESO* will use reasonable efforts to study such requests.

Table 2-6: Table 3-8: Advance Approval Timelines and Eligibility

Advance Approval Process ⁷	Submission Requirement (Prior to Start of Coverage Period)	Approval Deadline (Prior to Start of Coverage Period)	Eligible Equipment
Quarterly Quarterly	3 months prior	1 month prior	All equipment types may be submitted
Weekly Weekly	17 days prior	10 days prior	<ul style="list-style-type: none"> • Critical equipment must be submitted • Non-critical and low-impact equipment may be submitted
3-Day 3-Day	5 <i>business days</i> prior	3 <i>business days</i> prior	<ul style="list-style-type: none"> • Non-critical equipment must be submitted • Low-impact equipment may be submitted
1-Day 1-Day	2 <i>business days</i> prior	1 <i>business day</i> prior	<ul style="list-style-type: none"> • Low-impact equipment must be submitted • Critical and non-critical equipment with low-impact attributes must be submitted

3.7.1.1 Submission Timelines for Outages Supporting External RCs Reliability Coordinators

(MR Ch.5 ss.6.2.2K and 6.4.6)

Process for submission – *Market participants* may be required to conduct *outages* to support work planned by external **RCs reliability coordinators**. In cases where *market participants* are unable to submit such *outage* requests for *advance approval* within the deadlines for *planned outages*, they are required to submit such *outages* with an ~~Urgent Priority Code~~ 'Urgent' priority code and refer to the **RC reliability coordinator** work request in the 'Purpose Description' field in the *outage* management system. The *IESO* will consider it as a *planned outage* when determining priority. ~~Refer to Section 2.2.1~~ Refer to section 3.2.1 for details on determining *outage* priority.

⁷ Refer to ~~Section 2~~ section 3.7.5 for submission timelines for *outage* requests to critical and non-critical equipment with low-impact attributes

Note: The *IESO's* obligation to assess such *outage* requests is based on the *interconnection agreement* with the external Reliability coordinator.

3.7.2 Quarterly Advance Approval Process

(MR Ch.5 ss. 6.2.2K, 6.4.1B and 6.4.20)

Application – The *IESO* facilitates long-term planning by offering *market participants* the option to receive approval for all *planned outages* up to eight months prior to the scheduled start time via the *Quarterly Advance Approval* process.

Priority – *Outages* submitted within this process get the highest priority compared to *planned outages* submitted under other timeframes, thus granting greater certainty to *market participants*. Refer to Section 2.2.1 Refer to section 3.2.1 for details on determining *outage* priority.



If an *outage* request is submitted for the *Quarterly Advance Approval* process after the submission deadline, the *outage* management system will automatically place the *outage* for assessment under the next *Quarterly, Weekly, 3-Three-Day* or *1-One-Day Advance Approval* process, as eligible, based on equipment criticality, 'Request Weekly AA' flag and planned start time.

Study and coverage periods – The study and coverage periods for the *Quarterly Advance Approval* process are as shown in 2-1.



Figure 23-1

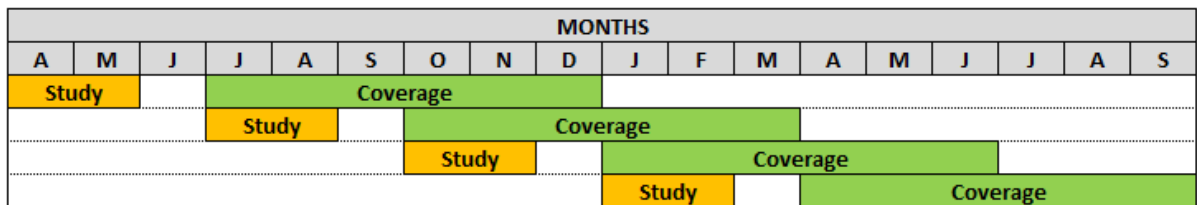


Figure 3-1: Quarterly Advance Approval Timeline

Study period for the *Quarterly Advance Approval* process begins at 00:00:00 EST on the first day of the period month and ends at 23:59:59 EST on the last day of the period month as shown in Figure 23-1. Coverage period for the *Quarterly Advance Approval* process begins 00:00:00 EST on the first day of the period month and ends at 23:59:59 EST on the last day of the period month as shown in Figure 23-1.

Note: The timelines for submission and assessment are inclusive of statutory holidays in Ontario and Saturdays and Sundays (Saturdays and Sundays hereafter referred to as weekend days).

IESO response – By the end of the study period, the *IESO* will either:

- ~~Provide~~*provide* *advance approval*, or
- ~~Place~~*place* the *outage* request in the 'At Risk' status

Resubmission – *Market participants* may choose to resubmit an *outage* placed in the 'At Risk' status at the end of a ~~Quarterly~~*quarterly* study period. Resubmitted *outage* requests will retain the priority date of the original *outage* request if:

- the original *outage* was scheduled to begin in the first three months of the current coverage period~~;~~ and
- it is resubmitted before the next study period~~;~~ and
- the resubmitted *outage* is scheduled to begin during the corresponding six-month coverage period ~~(MR Ch. 5, Sec. 6.4.20).~~

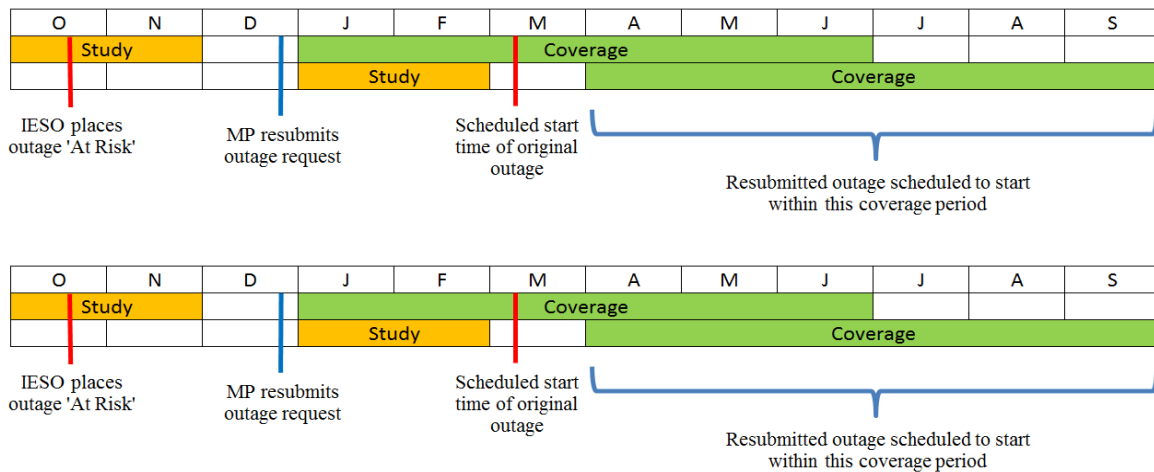
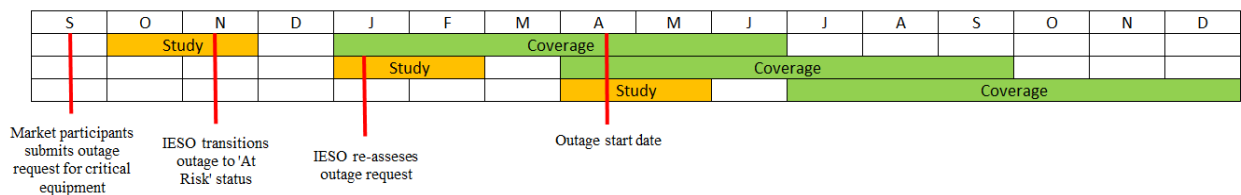


Figure 2-2-3-2: Criteria for 'At Risk' Outage Retaining Original Priority

IESO assessment – The *IESO* will ~~re-assess~~*reassess* *outages* placed in the 'At Risk' status at the end of the *Quarterly* study period during the next *Quarterly*, *Weekly*, or ~~3~~*Three-Day Advance Approval* process, as applicable based on equipment criticality and the status of the 'Request Weekly AA' flag.

Example A:



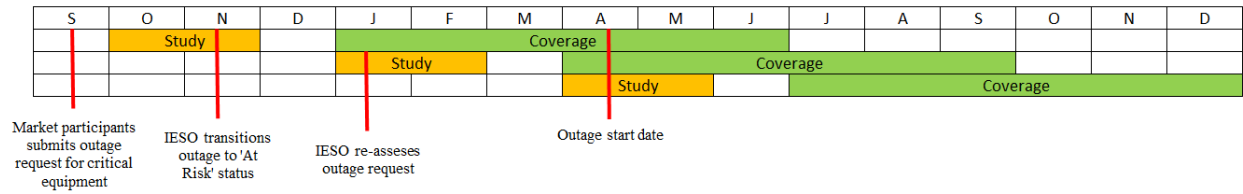


Figure 2-3:3-3: 'At Risk' Outage Reassessment – Example A

Example – In the above figure, the *market participant* submits a request in September for an *outage* to critical equipment beginning in April of the following calendar year. The *IESO* studies the request during the October-November study period and transitions the *outage* to 'At Risk' status.

January-February study period – The *IESO* will ~~re-assess~~reassess the request during the January-February study period for ~~Quarterly Advance Approval~~quarterly advance approval.

If...	Then...
The <i>IESO</i> transitions the request to 'At Risk' status during the January-February study period	The <i>outage</i> will be re-assessed reassessed in the next <i>Weekly Advance Approval</i> study period

Example B:

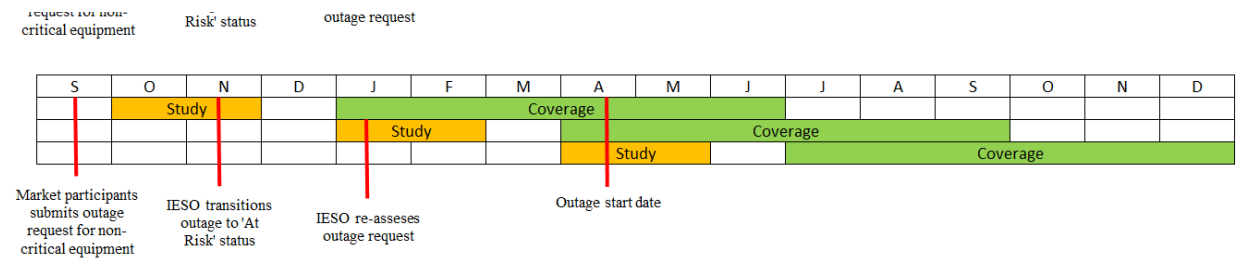


Figure 2-4:3-4: 'At Risk' Outage Reassessment – Example B

Example – Using the same timelines as Example A, the *market participant* submits an *outage* request for non-critical equipment for ~~Quarterly Advance Approval~~quarterly advance approval. If the *IESO* transitions it to 'At Risk' status during the October-November and the January-February study periods, the *outage* will be ~~re-assessed~~reassessed during the next ~~3~~Three-Day Advance Approval process.

If...	Then...
The <i>outage</i> request has the 'Request Weekly AA' flag	The <i>IESO</i> will re-assess reassess the request in the next <i>Weekly Advance Approval</i> process following the February study period

3.7.3 Weekly Advance Approval Process

(MR Ch.5 ss.6.2.2K, 6.4.1C and 6.4.9)

Application – *Planned outage* requests for critical equipment must be submitted for *Weekly Advance Approval*.

Market participants may also submit *planned outage* requests containing only non-critical or low-impact equipment under this process by selecting the “Request Weekly AA” flag in the *outage* management system.

Priority – *Outages* submitted within this process get a higher priority compared to *planned outages* submitted under ~~3-Day~~three-day and ~~1-Day~~timeframes one-day time frames, thus granting greater certainty to *market participants* for *outages* to non-critical or low-impact equipment (that are required to be submitted within the ~~3-Day~~three-day and ~~1-Day~~one-day processes respectively). Refer to Section 2.2.1 section 3.2.1 for details on determining *outage* priority.

feature will not allow the *outage* submission to be completed.

As explained in section 3.1, the criticality of equipment will be auto-populated in the *outage* management system during *outage* submission. If *outages* to critical equipment are not submitted within the *Weekly Advance Approval* process, the tool’s auto-validation feature will not allow the *outage* submission to be completed.

Mandatory and optional requests considered together – The *IESO* will also study *outages* with critical equipment and non-critical or low impact equipment with the “Request Weekly AA” flag placed in the ‘At Risk’ status from the *Quarterly Advance Approval* process during this time.

Study and coverage periods – The study and coverage periods for the *Weekly Advance Approval* process are as shown in 2-5.

		DAYS						
		S	M	T	W	T	F	S
WEEKS	1							
	2	Study						
	3							
	4	Coverage						
	5							

		DAYS						
		S	M	T	W	T	F	S
WEEKS	1							
	2	Study						
	3							
	4	Coverage						
	5							

Figure 23-5.

Figure 3-5: Weekly Advance Approval Timeline

Study period for the *Weekly Advance Approval* process begins at 16:00:00 EST on Friday and ends at 15:59:59 EST on the following Friday as shown in Figure 23-5.

Coverage period for the *Weekly Advance Approval* process begins 00:00:00 EST on Monday and ends at 23:59:59 EST on the following Sunday as shown in Figure 23-5.

Note: The timelines for submission and assessment are inclusive of statutory holidays in Ontario and weekend days.

Example – For example, if the *outage* is scheduled to start on a Monday, the request must be submitted at least 17 days prior to the start of the *outage*. If the *outage* is scheduled to start on a Friday, the request must be submitted at least 21 days prior to the start of the *outage*.

IESO response – By the end of the study period, the *IESO* will either:

- Provide a *Weekly Advance Approval*; or
- Reject the *outage* request

Note: *Outage* requests rejected during the *Weekly Advance Approval* process will not be re-assessed by the *IESO*. Market participants may resubmit rejected *outages* as new requests.

Revocation – At this stage, the *IESO*, based on significant changes in system conditions such as *forced outages* and changes to Ontario *demand* forecast, may also revoke *Quarterly Advance Approvals* if implementation of the *outage* will impact the *reliability* of the *IESO-controlled grid* (MR Ch. 5, Sec. 6.4.9).

3.7.4 Three-Day Advance Approval Process

(MR Ch.5 ss.6.2.2K, 6.4.1D and 6.4.9)

Application – *Planned outage* requests for non-critical equipment must be submitted for *3-Day Advance Approval*.

Optional requests – Market participants may also submit *planned outage* requests containing only low-impact equipment under this process. *Outages* submitted within this process get a higher priority compared to *planned outages* submitted under ~~1-Day~~ **one-day** timeframe, thus granting greater certainty to *market participants* for *outages* to low-impact equipment (that are required to be submitted within the ~~1-Day~~ **one-day** process). Refer to ~~Section 2.2.1~~ **section 3.2.1** for details on determining *outage* priority.

Other requests considered – The IESO will also study *outages* with non-critical equipment placed in the 'At Risk' status from the *Quarterly Advance Approval* process during this time.

Study and coverage periods – This process repeats daily on *business days* with study and coverage periods as shown in Figure 23-6.

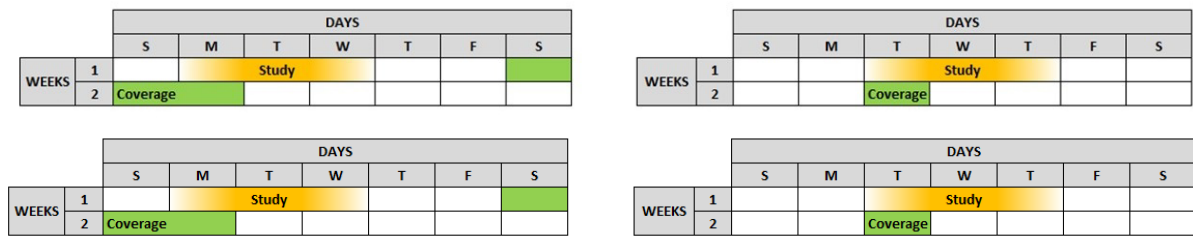


Figure 2-6: Three-Day Advance Approval Timeline

Note: In Figure 23-6, the timeline on the left illustrates a coverage period that falls on a weekend, and the timeline on the right illustrates a coverage period that falls on a weekday.

Study period for the **3-Three-Day Advance Approval** process begins at 16:00:00 EST on *business days* and ends at 15:59:59 EST, two *business days* later as shown in Figure 23-6.

Coverage period for the **3-Three-Day Advance Approval** process begins 00:00:00 EST on the fifth *business day*⁸ after the beginning of the study period, and ends at 23:59:59 EST on the same *business day*, as shown in Figure 23-6.

IESO response – By the end of the study period, the IESO will either:

- **Provide** an *advance approval*; or
- **Reject** the *outage* request.

Note: *Outage* requests rejected during the **3-Three-Day Advance Approval** process will not be **re-assessed** by the IESO. Market participants may resubmit rejected *outages* as new requests.

⁸ Statutory holidays and weekend days that precede a *business day* are included in that *business day* (i.e. Saturday, Sunday and Monday equal one *business day*).

Revocation – At this stage, the IESO may also revoke ~~Quarterly~~ *quarterly* and ~~Weekly Advance Approvals~~ *weekly advance approvals* if implementation of the outage will impact the reliability and/or operability of the IESO-controlled grid (~~MR Ch. 5, Sec. 6.4.9~~ *3.7.5, Sec. 6.4.9*).

One-Day Advance Approval Process

(MR Ch.5 s.6.4.9)

Application – *Planned outage* requests containing only low-impact equipment must be submitted for ~~1-Day Advance Approval~~ *one-day advance approval*.

Market participants may also submit *planned outage* requests containing critical and non-critical equipment with low-impact attributes under this process, if eligible. ~~Appendix D~~ *Appendix C* lists eligibility criteria for ~~1-Day Advance Approval~~ *one-day advance approval*.

This provides additional flexibility to *market participants* who are otherwise required to submit *outages* to critical and non-critical equipment in the *Weekly* and ~~3~~ *Three-Day Advance Approval* processes, respectively.

Eligibility – Refer to ~~Appendix D~~ *Appendix C* for a list of eligibility criteria for ~~1~~ *One-Day Advance Approval*.

For example,

Table 3-9: One-Day Advance Approval Eligibility Example

If...	Then...
A <i>market participant</i> submits an <i>outage</i> request, less than five <i>business days</i> prior to the scheduled start time, to a <i>generation facility resource</i> or, if applicable, an <i>electricity storage facility resource</i> with a 'Automatic Voltage Regulation or Power System Stabilizer Out of Service (AVR/PSS OOS)' Constraint Code <i>AND constraint code and</i> answers "Yes" to the "Only a Loss of Redundancy" question	The <i>outage</i> will be eligible for 1-Day Advance Approval <i>one-day advance approval</i> .

Study and coverage periods – The ~~1~~ *One-Day Advance Approval* process repeats daily with study and coverage periods as ~~shown~~ *displayed* in Figure ~~23~~ *7*.






Figure 2-7-3-7: One-Day Advance Approval Timeline

Note: In Figure 23-7, the timeline on the left illustrates a coverage period that falls on a weekend, and the timeline on the right illustrates a coverage period that falls on a weekday.

Study period for the ~~±~~One-Day Advance Approval process begins at ~~16~~10:00:00 EST on *business days* and ends at ~~13~~07:59:59 EST, one *business day* later, as ~~shown~~displayed in Figure 23-7.

Coverage period for the ~~±~~One-Day Advance Approval process begins 00:00:00 EST on the second *business day*⁹ after the beginning of the study period and ends at 23:59:59 EST on the same *business day*, as ~~shown~~displayed in Figure 23-7.

IESO response – By the end of the study period, the IESO will either:

- ~~Provide~~provide an *advance approval*,~~i~~ or
- ~~Reject~~reject the *outage* request.

Revocation – At this stage, the IESO may also revoke ~~Quarterly, Weekly~~quarterly, weekly and ~~3-Day Advance Approval~~three-day *advance approvals* if implementation of the *outage* will impact the *reliability* and/or operability of the IESO-controlled grid (~~MR Ch. 5, Sec. 3.7.6-4.9~~).

~~3.7.6-4.9~~.

Auto Advance Approvals

Application – *Outage* requests for low-impact equipment or equipment containing low-impact attributes may be eligible for ~~Auto Advance Approval~~auto *advance approval* (Auto AA) when submitted via the *outage* management system.

Eligibility assessment – *Market participants* are required to answer certain questions to determine their eligibility for Auto AA. ~~Refer to Appendix D – Column D in the table~~Appendix C, Table C-1, Column D lists the questions that will be asked to *market participants* during *outage* request submission to determine eligibility for Auto AA.

Based on the answers provided by *market participants*, the tool will establish eligibility for and grant Auto AA. The tool will also check that there are no conflicting *outages*, as explained in ~~Section 3.2.3~~section 4.2.3.

⁹ Statutory holidays and weekend days that precede a *business day* are included in that *business day* (i.e. Saturday, Sunday and Monday equal one *business day*).

Exclusions – The IESO also has the ability to mark equipment for exclusion from the Auto AA process. For example, breaker failure protection *outage* to a critical breaker could be excluded from Auto AA despite correctly responding to the low-impact questions outlined in Appendix DC.

Priority – Priority for *outages* that are granted Auto AA will be based on the time of submission and *advance approval* process they would have been manually studied in by the IESO. This ensures the priority is aligned with the IESO’s manual assessment of the *outage*.

Example – For example, if an *outage* request with non-critical equipment was submitted and auto-approved within the ~~Quarterly~~ *quarterly* process it would have a ~~Quarterly Advance Approval~~ *quarterly advance approval* priority. However, if the same *outage* request was submitted and auto-approved after the ~~Quarterly~~ submission deadline, it would have a ~~3-Day Advance Approval~~ *three-day advance approval* priority, based on equipment criticality and submission timeframe.

Going back to the example stated in ~~Section 2~~ *section 3.7.5*, the *outage* request for the *generation facility resource* or, if applicable, *electricity storage facility resource*, is deemed eligible for ~~1-Day Advance Approval~~ *Now, one-day advance approval*.

Table 3-10: Auto Advance Approval Example

If...	Then...
<p>A <i>market participant</i> submits an <i>outage</i> request, less than five days prior to the scheduled start time, to a <i>generation facility resource</i> or, if applicable, <i>electricity storage facility resource</i> with a 'Automatic Voltage Regulation or Power System Stabilizer Out of Service (AVR/PSS OOS)' Constraint Code, AND constraint code, and</p> <p>The <i>market participant</i> answers the low-impact question as follows:</p> <p>Only a Loss of Redundancy? = YES</p>	<p>The <i>outage</i> will be granted Auto AA with a 1-Day Advance Approval <i>one-day advance approval</i> priority</p>

If...	Then...
<p>A <i>market participant</i> submits an <i>outage</i> request, 18 days prior to the scheduled start time, to a <i>generation facility resource</i> or, if applicable, <i>electricity storage facility resource</i> with a 'Automatic Voltage Regulation or Power System Stabilizer Out of Service (AVR/PSS OOS)' Constraint Code, AND constraint code, and</p> <p>The <i>market participant</i> answers the low-impact question as follows:</p> <p>Only a Loss of Redundancy? = YES</p>	<p>The outage will be granted Auto AA with a Weekly Advance Approval <i>weekly advance approval</i> priority</p>

Manual assessment – The tool offers certainty to *market participants* by way of the automated approval, however *outage* priority will be based on manual assessment.

3.7.7 Final Approval in Advance

Application and eligibility assessment – A subset of *outages* for low-impact equipment or equipment containing low-impact attributes that are deemed eligible for Auto AA may receive ~~Final Approval~~ *final approval* in ~~Advance~~ *advance* (FAA). The IESO determines eligibility for FAA based on the impact to the *IESO-controlled grid*, on a case by case basis. ~~Refer to Appendix C for criteria used to grant FAA.~~

~~Refer to Appendix D for criteria used to grant FAA.~~

Confirmation – The *outage* management system will transition the *outage* request to 'Auto AA' status and display a flag for *market participants* to confirm the *outage* request is eligible for FAA. On the day of the *outage*, the tool will automatically transition the *outage* to 'Final Approved' status.

~~For example,~~

Table 3-11: Final Approval in Advance Example

If...	Then...
<p>A <i>market participant</i> submits an <i>outage</i> request, five days prior to the scheduled start time, to a <i>generation facility resource</i> or <i>electricity storage facility resource</i> with a 'Protection Out of Service (PROT OOS)' Constraint Code <i>constraint code</i> and provides the</p>	<p>The <i>outage</i> will be transitioned to 'Auto AA' status and a flag will be displayed to confirm the <i>outage</i> is eligible for FAA.</p> <p>On the day of the <i>outage</i>, the <i>outage</i> request will be automatically transitioned to 'Final Approved' status.</p>

If...	Then...
following answer to the low-impact question: <ul style="list-style-type: none"> • “Only a Loss of Redundancy?” = YES and <ul style="list-style-type: none"> • Max Recall is ≤ 15 minutes 	The <i>market participant</i> is not required to request final approval to implement the <i>outage</i> .

No final approve request needed – *Market participants* who have received FAA for their *outages* are not required to request final approval in order to implement the *outage*.

Revocation – The *IESO* may revoke the FAA of an *outage* request if it impacts the *reliability* and/or operability of the *IESO-controlled grid* and notify the *market participant*. In such cases, the *market participant* must verbally request final approval to commence the *outage* by telephoning the *IESO*.

Already scheduled out-of-service – *Outage* requests submitted for equipment that is already scheduled out-of-service under a single, *planned outage* request with an ‘Out-of-Service (OOS)’ Constraint Code constraint code will be eligible for FAA provided the new *outage* request:

- Contains the same or a subset of the equipment scheduled out-of-service;
- Has an overall and period level planned start and end date that is the same, or within the same time period, as the existing *outage* request; and
- Has been manually selected by the *IESO* to be eligible for FAA.

3.7.8 Submission Deadlines

Figure 2-8 **Timelines** – Table 3-12 displays *outage* submission and *IESO* review timelines.

Table 3-12: Outage Submission and IESO Review Timeline

Timeline	Action
At least three (3) months prior to coverage period start	Submit <i>outage</i> requests for <u>Quarterly Advance Approval</u> <i>quarterly advance approval</i>
One (1) month prior to coverage period start	<i>IESO</i> approves or transitions the <i>outage</i> into At-Risk status for the quarterly period

<u>Timeline</u>	<u>Action</u>
By 16:00 EST at least 17 days prior to coverage period start	Submit <i>outage</i> requests for Weekly Advance Approval <i>weekly advance approval</i>
By 16:00 EST One (1) week prior to coverage period start	<i>IESO</i> approves or rejects the request for <i>Weekly Advance Approval</i> .
By 16:00 EST Five (5) business days prior to coverage period start	Submit <i>outage</i> request for 3three-day Advance Approval <i>advance approval</i>
By 16:00 EST Three (3) business days prior to coverage period start	<i>IESO</i> approves or rejects the request for 3three-day Advance Approval <i>advance approval</i>
By 16 10:00 EST Two (2) business days prior to coverage period start	Submit <i>outage</i> request for 1one-day Advance Approval <i>advance approval</i>
By 14 08:00 EST One (1) business day prior to coverage period start	<i>IESO</i> approves or rejects the request for 1one-day Advance Approval <i>advance approval</i>
Just prior to <i>outage</i> start	Request final approval to begin <i>outage</i> (Not applicable for <i>outages</i> that receive final approval in advance) <i>IESO</i> provides final approval or revokes <i>advance approval</i>
After <i>IESO</i> provides final approval	Implement <i>outage</i>

~~Figure 2-8: Outage Submission and IESO Review Timeline~~

– End of Section –

4 Outage Management Procedures

Procedural Workflow

4.1 Facility Registration

(MR Ch.1 s.14; MR Ch.5 ss.3.4.1, 3.5.1, 3.6.1, 3.7.1 and 3.8.1)

Information requirements – *Market participants* are required to submit information regarding new or changes to existing *facilities* and equipment to the IESO via the online registration process outlined in ~~Market Manual~~ **MM 1.5**: Market Registration Procedures.

IESO assessment – The IESO will assess the submitted information to determine whether the equipment affects the operation of the *IESO-controlled grid* and communicate ~~their~~its assessment to *market participants* via [Online IESO](#). *Market participants* are notified of their equipment's criticality level at this point. Changes to the *IESO-controlled grid* or system operating limits may require the IESO to review and update criticality levels of equipment.

Outage reporting – *Market participants* whose *facilities* or equipment are determined to impact the *IESO-controlled grid's reliability* will be required to report *outages* to the IESO. ~~Refer to Appendix B~~Refer to [Appendix A](#) for the detailed criteria that the IESO uses to assess *outage*-reporting requirements. *Outages* to system auxiliaries associated with this equipment must also be reported as identified in ~~Appendix B~~[Appendix A](#).

Exemptions – *Market participants* may submit ~~an~~ a *market rule exemption application* according to the process outlined in the ~~Market Manual~~ **MM 2.2**: [Exemption Application and Assessment](#) procedure to apply for *facility* equipment to be entirely or partially exempted. Requests for *exemptions* from *outage* reporting are assessed by the IESO on a case-by-case basis as specified in ~~MR Ch. 1~~See [s.14](#). Assessments are communicated to *market participants* via [Online IESO](#).

Control centres – *Market participants* may also register one or more *control centres* via the online registration process to represent the location of their real-time operations. This facilitates the submission of *outages* that are not associated to a particular station, (e.g. SCADA systems).

4.2 Outage Coordination

(MR Ch.5 ss.6.1.1 and 6.1.3)

Role of IESO – The *IESO* facilitates the *outage* coordination process for *market participants* by providing the following:

- ~~Undesirable~~identifying undesirable situations – ~~outlined in this manual~~refer to section 4.2.1;
- ~~Outage~~outage planning guidelines – confidential reports published by the *IESO* and embedded in the *outage* management system;
- ~~Conflicting Constraint Codes~~conflicting constraint codes – embedded in the *outage* management system;
- ~~Conflict~~conflict checking feature – embedded in the *outage* management system;

~~4.3.14.1~~ Outage Coordination for Capacity Exports

- ~~Outage Coordination~~outage coordination for capacity exports;
- outage coordination for *generator-backed capacity import resources*; and
- *IESO* Reports – public reports published by the *IESO*.

~~4.3.14.2.1~~ Undesirable Situations

~~(MR Ch.5 ss.6.1.1 and 6.1.3)~~

Criteria – When assessing *outage* requests, the *IESO* will use the following general criteria to identify any undesirable situations the *outage* request may result in:

- ~~Negative~~negative impacts on the *reliability* (*security* and/or *adequacy*) and/or operability of the *IESO-controlled grid*; or
- ~~Capacity~~capacity and *energy* shortfalls; or
- ~~Material~~material impact on the operation of the *IESO-administered markets* (~~MR Ch. 5, Sec. 6.1.1~~); or

Repositioning – *Market participants* may request to reposition their scheduled *outages* based on their priority date, to avoid these undesirable situations.

~~4.3.24.2.2~~ Outage Planning Guidelines

~~(MR Ch.5 ss.6.1.1 and 6.1.3)~~

Purpose – The *IESO* will issue confidential *outage* planning guidelines to facilitate the assessment of grid *reliability*. The *outage* planning guidelines will assist *market participants* to avoid undesirable situations when scheduling *outages*. The guidelines will provide the following information:

4.2.2.1 Transmission Group:

Definition – Transmission Group is the category used to group associated transmission elements and/or *generation facilities* and/or *electricity storage facilities*, specified along with ~~timeframe~~the relevant time frame. There are some groups with the same name succeeded by a number. These were created to account for all possible combinations of the elements within that group. For example, if the original Transmission Grouping was defined as Group A, for implementation it was broken down into Group A (1) and Group A (2) as ~~follows~~shown below in Table 4-1:

Table 4-1: Transmission Groupings

Transmission Grouping	Transmission Element	Threshold	
Group A	Line A/Line B Line C	1	} Original Group
Group A (1)	Line A Line C	1	
Group A (2)	Line B	1	} Implemented Groups
	Line C		

4.2.2.2 Timeframe: Time Frame

Definition – Time frame refers to the applicable seasonal ~~timeframe~~time frame, specified with the transmission group name. Where not specified, the group will apply throughout the year. -Table ~~3-14-2~~ defines seasonal ~~timeframe~~time frames:

Table 3-1+4-2: Seasonal Timeframe

<u>Timeframe</u>	<u>From</u>	<u>To</u>
All season	01-Jan	31-Dec
<u>Spring</u>	<u>15-Mar</u>	<u>14-May</u>
Summer	15-May	14-Sep
<u>Fall</u>	<u>15-Sep</u>	<u>14-Nov</u>
Winter	15-Nov	14-Mar

<u>Spring</u>	<u>15-Mar</u>	<u>14-May</u>
<u>Fall</u>	<u>15-Sep</u>	<u>14-Nov</u>

4.2.2.3 Element:

Definition – Element refers to the specific piece of equipment within the group.

Note: The bus must be included in the *outage* request if all bus breakers are out of service. The line disconnect must be included in the *outage* request if all terminal breakers are out of service.

4.2.2.4 Threshold:

Definition – Threshold refers to the number of elements from the list that are permitted out of service at one time.

Example – For example, a threshold of 2 means only two elements from the list can be scheduled out of service at the same time without any conflict.

4.2.2.5 Reason:

Definition – Reason refers to the phenomena causing the conflict. This is based on the IESO's assessment of situations that would/could potentially:

- compromise the *reliability* of the transmission system;
- result in the inability to maintain the system within system operating limits using normal operating procedures; or
- result in the inability to restore the transmission system to normal operating conditions following a respected contingency.

Example – For example, phenomena might comprise of pre- and post-contingency thermal concerns, pre- and post-contingency voltage concerns, pre- and post-contingency stability concerns, black-start restoration paths, or *resource* constraints.

4.2.2.6 Distribution

Definition – *Distribution refers to* the list of *market participants* who will be notified of the *outage* planning guideline. The distribution list will only include those *market participants* that own or operate equipment in the transmission group.

Example – For example, in Table 4-3-2 below, all *market participants* that own or operate any section of Line X will be on the distribution list. *Outages* for equipment tapped off Line X would not be restricted and therefore, would not be on the distribution list.

Table 3-2: Table 4-3: Sample Outage Planning Guideline

Transmission Group	Transmission Elements	Threshold	Reason	Distribution
Group 1	Line X	1	Thermal concerns	
	Line Y			

Access – *Market participants* will be able to access the guideline at the [IESO Reports](#) webpage under Participant Reports. The *IESO* will periodically review the *outage* planning guideline and updates will be published as per the Baseline schedule.

4.3.34.2.3 Conflicting Constraint Codes

(MR Ch.5 ss.6.1.1 and 6.1.3)

Definition – Upon submission of *outage* requests, the *outage* management system will check *outages* for equipment with conflicting ~~Constraint Codes~~ *constraint codes* for the same time period. For example, Generator A has an *outage* request with 'ABNO' ~~Constraint Code~~ *constraint code* that overlaps with another request for Generator A to be ~~00S'00S'~~.

Criteria – *Outage* requests are considered to be in conflict when all of the following are true:

- ~~The~~ *the* *outage* request priority codes are Forced, Forced Extended, Urgent, Planned or Opportunity, ~~and;~~
- the *outage* requests overlap for any length of time, ~~and;~~
- the *outage* requests have a status of Submitted, Study, Negotiate, At Risk, Advance Approved, or Implemented, ~~and~~

- the *outage* request periods share the same equipment and have constraint codes that are flagged to be in conflict with each other as shown in Table ~~3-3~~ below 4-4:

Table ~~3-3~~ 4-4: Outage Request Constraint Code Conflicts

	OOS	IS	DRATE	HOLD OFFH OLD OFF	MUSTR UNMUS T RUN	BTCT	PROT OOS	BF PROT OOS	AVR/ PSS OOS	ASP OOS	INFO	ABNO
OOS		X										X
IS	X											X
DRATE												
HOLD OFFHOLD												
MUST RUNMUSTRU T												X
BTCT						X						
PROT OOS							X					
BF PROT OOS								X				
AVR/PSS OOS									X			
ASP OOS										X		
INFO												
ABNO	X	X			X							X

Additional criteria – In addition to the conditions described above, *outage* requests that meet any of the following conditions will also be considered to be in conflict:

- ~~The~~ *outage* request’s equipment are on the same undesirable *outage* combination~~;~~
- UFLS validation fails~~;~~
- ~~Outage~~ requests with BF PROT OOS constraint codes are overlapping at the same stations.

For example,

Table 4-5: Constraint Code Conflict Example

If...	Then...
Outages for Line 1 A PROT OOS and Line 1 B PROT OOS overlap	The outage management system will display a conflict
Line 1 A PROT OOS and Line 2 B PROT OOS overlap	The outage management system will NOT display a conflict

4.3.44.2.4 Conflict Checking

(MR Ch.5 ss.6.1.1 and 6.1.3)

Tool interface – The *outage* planning guidelines and conflicting constraint codes are embedded in the *outage* management system. If a submitted *outage* request is in conflict with another *outage* based on these criteria, the tool will display:

- **Anan** error message that the *outage* is in conflict;
- ID number of the *outage(s)* it is in conflict with (details regarding the conflicting *outage* are classified as *confidential information* and will be visible to *market participants* based on viewership rights); and
- **Requirement** to provide a rationale for the conflict to be allowed (details on conflict rationale are provided below).


Rescheduling – *Market participants* may determine the planned times of the conflicting *outage(s)* (either via the *outage* ID number or by contacting the *IESO*) and reschedule the *outage* to avoid the conflict.

4.3.4.14.2.4.1 Conflict Rationale

Criteria – *Outage* requests having conflicts may be submitted as long as *market participants* provide a rationale for doing so. A complete rationale is required for the *IESO* to consider the *outage* – that is, for clearance the *market participant* must identify how the pieces of equipment are related, physical proximity, and the reason why other control actions are not available. Table 3-4 below lists criteria for the *IESO* to consider *outages* based on conflict rationale.

Table 3-4:

Table 4-6: Criteria for Conflict Rationale Acceptance

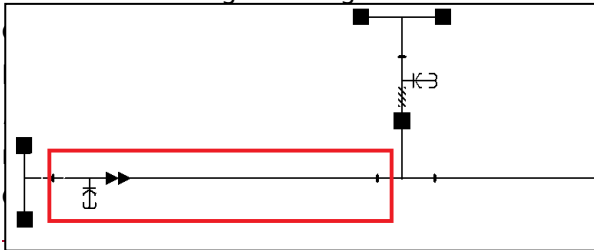Advance Approval Process	Acceptable Conflict Rationale Description	Examples
Quarterly Advance Approval process	Only non-discretionary rationale will be accepted	<ul style="list-style-type: none"> • Clearance • Degradation of protection or cooling • Vacuum building <i>outage</i>
Weekly, 3 <i>Three-Day</i> and ± <i>One-Day</i> Advance Approval processes	Discretionary rationale may be considered provided there is valid justification	<ul style="list-style-type: none"> • Favourable Ambient Conditions/Short Duration: the reason for the <i>outage</i> conflict is for thermal concerns, but the <i>outage</i> is scheduled overnight during lower load  <ul style="list-style-type: none"> • Partial Equipment <i>Outages</i>: Situations when only certain sections of the line are being taken out of service as shown in the diagram below, wherehere the path critical to the transfer of power is not interrupted. <u>An example of a partial equipment outage is in Figure 4-1.</u> • Short Recalls: Conflicts for post-contingency concerns may be resolved by recalling the outage within 15 minutes.
Real-time process	Conflicts will only be considered for forced and urgent <i>outages</i>	<ul style="list-style-type: none"> • <i>Forced outage</i> to equipment for <u>due to a situation that could potentially endanger the safety of any person, damage equipment, or violate any applicable law (e.g. environmental concern)</u>

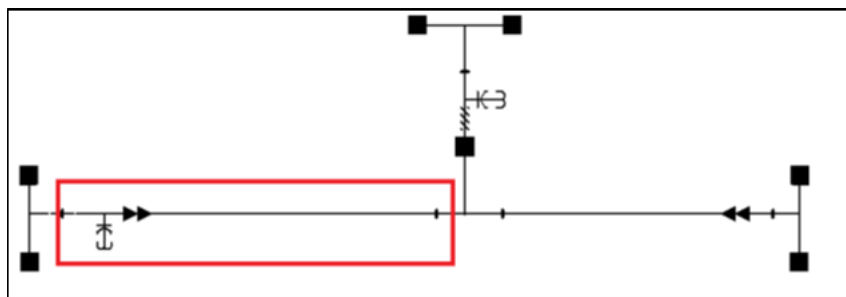


Figure 4-1: Partial Equipment Outage Example

IESO evaluation – The *IESO* will evaluate submitted rationale on a case-by-case basis and determine whether to allow the conflict to proceed or require the *market participant* to reschedule.

Notice to market participants – If the rationale does not meet the criteria described above and is deemed insufficient, the *IESO* will notify the *market participant* to reschedule the *outage*.

4.3.54.2.5 IESO Reports

The *IESO* publishes near-term and long-term reports to assist *market participants* in scheduling their *outages* when they are more likely to receive approvals:

4.2.5.1 ~~Near-term reports: Term Reports~~

~~((MR Ch. 5 ss.7.1.1 and 7.3.1))~~

~~Adequacy Reports and Transmission Facility All-in-Service Limits Reports and Transmission Facility Outage Limits Reports contain demand forecasts and assessments for Ontario and are published by the IESO for informational purposes. Refer to [Market Manual MM 7.2: Near-Term Assessments and Reports](#) for further details on these reports.~~

4.2.5.2 ~~Long-term report: Term Report~~

~~(MR Ch.5 ss.7.1.1.4 and 7.3.1.2)~~

~~As per the market rules, the IESO prepares and publishes demand forecast, and a security and adequacy assessment for an 18-month period, on a quarterly basis (MR Ch. 5, Sec. 7.1.1.4 and 7.3.1.2). Refer to [Market Manual MM 2.11: Reliability Outlook and Related Information Requirements](#) for further details on this report.~~

~~1.2 Outage Coordination for Capacity Exports~~

4.3 Outage Coordination for Capacity Exports

~~(MR Ch.5 ss.6.4.4 and 6.4.13)~~

Contractual obligations – A Capacity Seller¹⁰ may have obligations with respect to the coordination of *outages* under applicable agreements with external *control areas*. Any such obligations are between the Capacity Seller and the external

¹⁰ Capitalized terms in this section are defined in ~~Market Manual MM 13.1: Capacity Export Requests, Appendix App A: Glossary of Capacity Export Terms.~~

control area or capacity buyer, and are in addition to the obligations that the Capacity Seller has pursuant to the *market rules* and *market manuals*.

~~The IESO will continue to review *outage* requests in accordance with this *market manual*. Any additional review of *outages* by the external *control area* pursuant to the applicable agreements is independent of the IESO's review.~~

External control area outage review is independent of IESO review – The IESO will continue to review *outage* requests in accordance with this *market manual*. Any additional review of *outages* by the external *control area* pursuant to the applicable agreements is independent of the IESO's review.

Outages to partially committed capacity – All *outages* and/or derates to a Capacity Resource that have partially committed capacity will be applied proportionally between capacity committed to the external *control area* and the *IESO-administered markets*. ~~For example, where there is an *outage* to a Capacity Resource that has committed a portion of its capacity to an external *control area* (e.g., 30% of installed capacity), the IESO will assess impacts to *adequacy* based on the uncommitted capacity portion (i.e., remaining 70% of installed capacity). For example, in a scenario where a *generator-backed capacity import resource* commits 100 MW to the external *control area* and 50 MW to the IESO through a *capacity obligation*, and experiences a 30 MW derate, the derate would be applied according to the 100:50 ratio representative of the allocation of the committed capacity between the external *control area* and the IESO. The 30 MW derate would correspond to a respective 20 MW and 10 MW supply reduction in the external *control area* and the IESO, and could limit the transaction associated with the *generator-backed capacity import resource* to 40 MW. In this example, the *generator-backed capacity import resource* would submit a 10 MW derate (i.e. derate to 40 MW) to the IESO.~~

4.3.1 Capacity Seller Requirement to Coordinate with Transmitters Prior to IESO Involvement

~~Refer to Market Manual 13.1: Capacity Export Requests, Section (MR Ch.5 ss.6.4.4A and 6.4.9.3)~~

Additional requirements – Refer to **MM 13.1: Capacity Export Requests ss.3:** Capacity Seller Requirement to Coordinate with Transmitters for information and requirements relating to coordination with *transmitters* regarding *outages* when submitting a *capacity export request* and prior to a Commitment Period.

Risk of grid-incapability to Capacity Resource – Should a *planned outage* to a *transmission facilities facility* arise whereby a Capacity Resource would be rendered Grid-incapable during a Commitment Period, the IESO may reject or revoke the *planned outage* provided certain conditions are met, including the Capacity Seller

having demonstrated that it has made best efforts to work with the *transmitter* to reschedule the *planned outage*.

Best efforts – In order to demonstrate to the *IESO* that it has made best efforts ~~have been made in the event such circumstances arise pursuant to MR Ch.5 ss. 6.4.4A.3 or 6.4.9.3.2~~, a Capacity Seller must communicate with the applicable *transmitter* as described in ~~Section 3 of Market Manual~~ **MM 13.1, s.3** and as set out below. The following explains the general process that the Prospective Capacity Seller should follow with the *transmitter* during the Commitment Period to demonstrate to the *IESO* that ~~best~~ reasonable efforts have been made to reschedule a *planned outage* should such circumstances arise:

1. Schedule a meeting (or multiple meetings, if necessary) in which it notifies the applicable *transmitter* of any capacity export commitments and determines if there are existing *planned outages* (unapproved or approved) that would render the Capacity Resource Grid-incapable at any time during the proposed Commitment Period.
2. Update the *outage* request (visible to the applicable *transmitter*)¹¹ in the *IESO*'s CROW system submitted in accordance with ~~Market Manual~~ **MM 13.1, Section s.3** with an ~~information~~ Information priority code, indicating the details of any capacity export commitments.
3. Throughout the Commitment Period, continue to check with the *transmitter* by, among other things, monitoring the CROW system, to determine if there are any *planned outages* during the proposed Commitment Period that would render the Capacity Resource Grid-incapable.
 - a. Should there be *planned outages* during the proposed Commitment Period that would render a Capacity Resource Grid-incapable for, work with the *transmitter* to address the conflict, for instance:
 - i. The *transmitter* may agree to reschedule the *planned outage*.
 - ii. The *transmitter* may accept the risk of potential rejection or revocation of the *planned outage* in the event that it is determined that the *planned outage* will, during the Commitment Period, pose an unacceptable risk of an *adequacy* shortfall to the external *control area*.
4. Whenever applicable, update the applicable *outage* request with the ~~information~~ Information priority code indicating any changes or new information, including the resolution of any conflicting *outages* that may arise.

¹¹ To setup Third Party Viewership in CROW which makes *outage* requests visible to the applicable *transmitter*, the *IESO* Equipment Registration Specialist (ERS) must follow the steps outlined in the [Online IESO Guide for all Contract Roles](#).

4.3.2 Capacity Seller Requirement to Coordinate with Transmitters Requiring IESO Involvement

~~If the~~ (MR Ch.5 ss.6.4.4A and 6.4.9.3)

Notice to IESO ~~is advised by the~~ **required** – The Capacity Seller ~~that~~ **must notify the IESO where** the external *control area operator* has determined that a *transmitter's planned outage* that would render a Capacity Resource Grid-incapable would ~~–~~:

- ~~–~~ result in an unacceptable risk of an *adequacy* shortfall to the *external control area*; and
- ~~–~~ the *transmitter* and Capacity Seller are not able to come to an agreement to reschedule the *planned outage*, ~~the Capacity Seller must contact the IESO.~~

Best efforts – The IESO will assess pursuant to MR Ch.5 ss.6.4.4A.3 or 6.4.9.3.2 whether the Capacity Seller has used its best efforts to reschedule the *planned outage* with the *transmitter* and whether any *reliability* concerns will arise if the *transmitter's planned outage* is rejected or revoked.

Outages required for reliability – Examples of transmission *outages* necessary for *reliability* include, but are not limited to:

- ~~Transmission~~ **transmission** *outages* that would prevent a future *forced outage* from occurring (e.g., a *load* supplied by a single transformer or line that would be forced out-of-service due to equipment concerns).
- ~~Transmission~~ **transmission** *outages* that would leverage opportune generation and *load* profiles (e.g., matching *outages* with seasonal generational support).
- ~~Transmission~~ **transmission** *outages* that would restore instantaneous protections and respective communication mediums.

Notice to Capacity Seller – If the IESO determines that the *outage* is for *reliability* purposes, the IESO will advise the Capacity Seller who may inform the external *control area operator*.

Rejection and revocation – If the IESO determines that ~~best~~ **reasonable** efforts have been made and there is no *reliability* concern, the IESO may reject or revoke the *planned outage* pursuant to ~~Market Rules Chapter~~ **MR Ch.5, Section s.6.4**. The IESO will not, pursuant to this section, recall *outages* to facilitate *called capacity exports* or reject or revoke *forced outages* or urgent *outages*, or *outages* that bottle a *resource's*¹² output.

¹² The *resource* is operating to a reduced maximum generation output due to constraints resulting from transmission element *outages*. This does not include constraints that limit the *resource* to 0 MW output.

4.4 Outage Coordination for Generator-Backed Capacity Import Resources

(MR Ch.5 ss.6.4.1, 6.4.4 and 6.4.13; Ch.7 s.3.5.6)

Prior submission – *Generator-backed capacity import resources* are required to submit *planned outage* requests to the IESO for approval prior to submitting the *outage* request to the external *control area*.

Offers must reflect derated capacity – All derates to a *generator-backed capacity import resource*, whether a *planned outage* or *forced outage*, shall be applied proportionally between the capacity committed to the IESO and the external *control area*. Import *offers* associated with the *generator-backed capacity import resource* shall reflect the ~~de-rated~~ **derated** capacity to the extent that such *generator-backed capacity import resource* has been de-rated below its *capacity obligation*.

Example – For example, in a scenario where a *generator-backed capacity import resource* commits ~~100MW~~ **100 MW** to the external *control area* and ~~50MW~~ **50 MW** to the IESO through a *capacity obligation*, and experiences a ~~30MW de-rate~~ **30 MW derate**, the ~~de-rated~~ **derate** would be applied according to the 100:50 ratio representative of the allocation of the committed capacity between the external *control area* and the IESO. The 30MW de-rate would correspond to a respective ~~20MW~~ **20 MW** and ~~10MW~~ **10 MW** supply reduction in the external *control area* and the IESO, and could limit the transaction associated with the *generator-backed capacity import resource* to ~~40MW~~ **40 MW**. In this example, the *generator-backed capacity import resource* would submit a ~~10MW de-rate~~ **10 MW derate** (i.e. derate to ~~40MW~~ **40 MW**) to the IESO.

Other boundary entity resource offers permitted – Although import *offers* associated with a *generator-backed capacity import resource* shall be placed on the applicable *boundary entity resource* for *generator-backed capacity import resources*, traders are not excluded from submitting import *offers* on other *boundary entity resources*.

External control area outages – In cases where there is a planned transmission *outage* within the external *control area* that would directly disconnect the *resource* from the external grid, ~~then when a capacity-backed transaction is scheduled, the IESO will not be required to resolve the conflict.~~ **The** *generator-backed capacity import resource* shall work with the transmission owner and or the external *control area balancing authority/reliability coordinator* to reschedule the planned *outage*, as per the requirements set out in the applicable external *control area's* rules and regulations. Any such obligations are between the *generator-backed capacity import resource* and the external *control area*, and are in addition to the obligations that the *generator-backed capacity import resource* has with the IESO pursuant to the *market rules* and *market manuals*.

~~The IESO will continue to review outage requests in accordance with this market manual. Any additional review of outages by the external control area pursuant to the applicable agreements is independent of the IESO's review.~~

Example codes – Table ~~3-5 below~~4-7 provides example codes for *generator-backed capacity import resources* when submitting *planned outage* requests.

~~Table 3-5:~~Table 4-1: Applicable Codes for Generator-backed Capacity Import Resources

Priority Code	Constraint Code	Purpose Code
Planned	DERATE or OOS	Other

4.5 Outage Submission

(MR Ch.5 ss.6.3.1 and 6.3.6)

Outage management system – *Market participants* submit *outages* through the *outage* management system and the *IESO* uses that tool to confirm receipt and communicate approval back to the *market participant*. *Market participants* access the *outage* management Application Programmatic Interface (API) either through:

- ~~The~~the *IESO*'s web link located in the [IESO Portal](#), or
- ~~Their~~their own *outage* management program.

Included information – Typically, an *outage* request will include the following information¹³:

~~Table 3-6:~~Table 4-2: Information Requirement during Outage Submission

Name of Field Name in the Tool	Information To Be Provided by Market Participants
Applicant	The <i>market participant</i> that is submitting the information.
Single Point of Contact (SPOC)	The request will identify a SPOC for the <i>market participant</i> , either an individual or a position, along with sufficient information to enable effective communication with that SPOC (such as phone, fax, or email). For <i>market participants</i> with direct input to the <i>outage</i> management system, contact information for responsible parties will be on file with the <i>IESO</i> .

¹³ Refer to the "Outage Management System CROW OCSS Web Client User Guide" for detailed instructions on how to submit an *outage* request.

Name of Field Name in the Tool	Information To Be Provided by Market Participants
Priority Code and Purpose Code	Each <i>outage</i> request must contain appropriate Priority <u>priority</u> and Purpose Codes. See Section 2 <u>purpose codes. Refer to sections 3.2 and 3.3</u> for more details.
Purpose Description	General information about the <i>outage</i> , such as a brief description of the purpose and specific requirements or information pertinent to the <i>outage</i> (for example "Loading levels for a <i>generation facility</i> test"). Any regulatory requirements for an <i>outage</i> must be included in this information.
Request Weekly AA	For non-critical or low impact equipment, indicate if the <i>outage</i> is submitted under the <i>Weekly Advance Approval</i> process.
Requested Equipment	Sufficient information must be provided to identify and describe, if required, the specific piece of equipment, using the equipment identification and location confirmed by the <i>IESO</i> in Market Manual 1.5: Market Registration Procedures <u>MM 1.5</u> .
Planned Start and End Date/Time	The submission must include the requested start date, start time, end date and end time.
Maximum Recall Time	The submission must include recall time, which is the total amount of time that would be required to return the equipment to service upon a request by the <i>IESO</i> . <i>Market participants</i> may submit optional comments to the <i>IESO</i> to provide more information.
Recurrence	This information will describe the periodic nature of the <i>outage</i> , that is, whether the <i>outage</i> is continuous, continuous except for weekends, daily, etc.
Constraint Code	Each piece of equipment on the <i>outage</i> request must contain a constraint code to specify the equipment limitations. This will be based on the status of the equipment when the <i>outage</i> is implemented (for example: OOS, IS, MUSTRUN). See Section 2.4 <u>Refer to section 3.4</u> for more details.
Equipment Description (Mandatory for Constraint Codes specified in Table 2-4 and Equipment Classes specified in Table C-1.)	General information about the equipment, such as a brief description of the status and condition of the equipment pertinent to the <i>outage</i> (for example " <i>Generation facility</i> <u>resource</u> unavailable for Black-black start"). Any regulatory requirements for an <i>outage</i> must be included in this information. <u>(Mandatory for constraint codes specified in Table 3-4 and equipment classes specified in Table B-1.)</u>

Name of Field Name in the Tool	Information To Be Provided by Market Participants
MW Impact	Indicate the impact, if any, on real power <i>resources</i> which will result from the <i>outage</i> . This would be the direct impact associated with the specific piece of equipment rather than an indirect impact.
MVAR Impact	Indicate the impact, if any, on reactive power <i>resources</i> that will result from the <i>outage</i> . This would be the direct impact associated with the specific piece of equipment rather than an indirect impact.
Conflict rationale	<p>This information will be used by the <i>IESO</i> to verify the importance of scheduling the <i>outage</i> in case of conflicts.</p> <p>Note: This field will not be visible to <i>market participants</i> with third party viewership.</p>
<p><i>Market participant to IESO</i> Comments</p>	<ul style="list-style-type: none"> • <i>Market participants</i> shall use this section to notify the <i>IESO</i> of any additional information, including details of their assessment, associated <i>outage</i> requests, switching details, etc. • <i>Generation facilities</i> and <i>electricity storage facilities</i> shall also use this section to notify the <i>IESO</i> of any intent to arrange for replacement <i>energy</i> in the form of imports (MR Ch. 5, Sec. s.6.3.6). When these arrangements are finalized, <i>market participants</i> shall provide the following information: <ul style="list-style-type: none"> ○ Thethe MW amount and duration;; ○ Thethe <i>intertie zone</i> or zones through which the replacement <i>energy</i> is intended to be scheduled, ○ Thethe <i>boundary entity resource</i> that shall submit the <i>offers</i> and schedule the replacement <i>energy</i> if dispatched by the <i>IESO</i>;; and ○ Informationinformation regarding the e-Tag associated with the import, including a unique identifier, tag ID or tag format to be used. <p>Refer to Section 5section 6 for details on arrangement of replacement <i>energy</i>.</p> <p>Note: This field will not be visible to <i>market participants</i> with only third party viewership access.</p>

Name of Field <u>Name in the Tool</u>	Information To Be Provided by Market Participants
Low-impact Questions	Based on the information submitted, <i>market participants</i> may be required to answer a few low-impact questions. This is to determine if the <i>outage</i> is eligible for 1-Day <u>one-day</u> AA, Auto AA, and/or FAA, as explained in Sections 2 <u>sections 3.7.5, 3.7.6 and 3.7.7</u> , respectively. Refer to Appendix D <u>Appendix C, Table C-1</u> , Column D in the table lists the questions that will be asked to <i>market participants</i> .

4.6 Outage Assessment

~~An~~ (MR Ch.5 s.6.4.4)

IESO assessment – The *IESO* ~~assesses~~ assesses ~~outage request is assessed~~ requests for ~~its~~ their potential impact on the *reliability* and/or operability of the *IESO-controlled grid* with respect to the following:

- ~~Reductions~~ reductions in system operating limits; ~~interconnection reliability~~ operating limits or changes in power transfers which encroach on a system operating limit;
- ~~Will~~ will or is reasonably likely to have an adverse impact on the *reliable* operation of the *IESO-controlled grid*;
- ~~Operating~~ operating limits available and adequate monitoring tools available;
- ~~Adequate~~ adequate system and area reserve;
- ~~Adequate~~ adequate pre/post contingency assessment; voltage levels; islanding concerns; equipment limits and control actions;
- ~~Adequate~~ adequate *ancillary services* requirements;
- ~~System~~ system (global) and *local area adequacy* – capacity and energy;
- ~~High~~ high-risk operating state, *conservative operating state*, or *emergency operating state* conditions; and

~~Duplicated~~ redundant supply *facilities* including *station service* supply and protection systems

Additional criteria – Refer to Market Manual MM 7.4: IESO-Controlled Grid Operating Policies for more details on the *IESO's* *reliability* assessment. The *IESO* may provide details of their assessment under the '*IESO to Market Participants Comments*' field in the *outage* management system.

Note: This field will not be visible to *market participants* with only third party viewership access.

4.6.1 Market Participant Updates

(MR Ch.5 ss.6.3.1 and 6.4.13)

Revised requests – *Market participants* may update an *outage* request while it is being assessed by the *IESO*. Changes other than the purpose description or comments require notification to the *IESO* by telephone. The *IESO* will assess the impact of the change. Revised *outage* requests will be assessed within the original study period.

Table 4-3: Market Participant Outage Request Updates

If the update is ...	The IESO shall...
<p>An insignificant change as explained in Section 2.2.1 Insignificant, as defined in section 3.2.1 of this market manual</p>	<p>Allow the <i>market participant</i> to update the request.</p>
<p>A significant change as explained in Section 2.2.1 Significant, as defined in section 3.2.1 of this market manual</p>	<p>Allow the <i>market participant</i> to update the request and revise the priority date.</p>

4.6.2 Outage Assessment Outcomes

~~Table 3-7 below describes~~The following subsections describe the next steps and associated obligations ~~following based on the possible outcomes of~~ the IESO's assessment of *outages*.

4.6.2.1 ~~Table Provide Advance Approval~~

~~(MR Ch.5 ss.6.4.3.3-7: Outage Assessment Outcomes, 6.4.8 and 6.4.10)~~

~~Next steps~~ – As per the timelines in section 3.7 of this *market manual*:

Table 4-4: Possible Next Steps after Providing Advance Approval

IESO Assessment Outcomes	Possible Next Steps	Associated Obligations
Provide advance approval (as per timelines in <u>Section 2.7</u>)	Final Approval	<p>On the day of the <i>outage</i>, <i>market participants</i> must contact the IESO Control Room via telephone when they are ready to proceed with the <i>outage</i>. The IESO will, in general, provide final approval to a <i>planned outage</i> unless it foresees an adverse <i>reliability</i> impact, based on ongoing <i>security</i> and <i>adequacy</i> assessments.</p> <p>When requesting final approval, <i>market participants</i> should give due consideration to any adjustments to:</p> <ul style="list-style-type: none"> • generation patterns; or • <u>injection patterns</u> (for <i>electricity storage facilities</i>; injection patterns); or • <u>system configuration</u>

IESO Assessment Outcomes	Possible Next Steps	Associated Obligations
		<p>required by the <i>IESO</i> prior to removal of equipment from service and the time required to effect these adjustments (MR Ch.5 See s.6.4.3.3).</p> <p><i>Outages</i> that are eligible for FAA will be automatically granted Final Approval at the beginning of the planned start date of the <i>outage</i>.</p>
	<p>Revocation</p>	<p><i>Market participants</i> have the option of resubmitting or canceling the <i>outage</i>. The <i>IESO</i> will work with <i>market participants</i> to re-schedule the <i>planned outage</i> to a date and time at which the <i>outage</i> will not likely have an adverse impact on the <i>reliability</i> and/or operability of the <i>IESO-controlled grid</i>. Where practical, the <i>IESO</i> will consider date and time preferences of <i>market participants</i> when re-scheduling the <i>outage</i> (MR Ch.5, See s.6.4.10).</p> <p>The original priority date is maintained if <i>market participants</i> re-submit <i>resubmit</i> the <i>outage</i> within five <i>business days</i> of being revoked (MR Ch.5, See s.6.4.10).</p>
	<p><i>Outage</i> Start Delays</p>	<p><i>Market participants</i> must inform the <i>IESO</i> if they expect their <i>outage</i> to be delayed from starting as scheduled and whether the delay is expected to result in a planned extension.</p>

IESO Assessment Outcomes	Possible Next Steps	Associated Obligations
		<ul style="list-style-type: none"> • Start of <i>outage</i> delayed by 30 minutes or less: <i>Market participants</i> must notify the <i>IESO</i> Control Room by telephone. • Start of <i>outage</i> delayed by greater than 30 minutes: <i>Market participants</i> must notify the <i>IESO</i> Control Room by telephone and update their <i>outage</i> request.
	<p>Planned Extension</p>	<p><i>Market participants</i> must submit requests for planned extensions as a new <i>outage</i> request. The new request must reference the <i>outage</i> ID of the on-going <i>planned outage</i> in the <i>outage</i> management system.</p> <p>The <i>IESO</i> will review planned extension requests on a reasonable effort basis if the <i>outage</i> request was scheduled to start and end on the same day. Otherwise the planned extension will be treated as a late submission and either rejected or revoked.</p> <p>The <i>IESO</i> will reject the request for planned extension if it is determined that the extension is likely to adversely impact the <i>reliability</i> and/or operability of the <i>IESO-controlled grid</i> or is likely to require the rescheduling, recall or revocation of a <i>planned outage</i> request previously submitted to the <i>IESO</i> (MR Ch.5, See s.6.4.8). In such cases, <i>market participants</i> shall ensure the <i>outage</i> duration does not exceed the originally approved <i>planned outage</i> or the period as advised by the</p>

IESO Assessment Outcomes	Possible Next Steps	Associated Obligations
--------------------------	---------------------	------------------------

~~IESO when rejecting the *outage* request (MR Ch.5, See s.6.4.8).~~

Negotiate to reschedule	Reschedule outage or advanced approval	Market participants must reschedule the <i>outage</i> following discussions with the IESO. The priority date of the original <i>outage</i> request will be retained during resubmission if completed within study timeframe.
	Cancellation	Market participants must cancel the <i>outage</i> request in the <i>outage</i> management system.
	Rejection (for <i>outages</i> submitted under the Weekly, 3-Day or 1-Day Advance Approval processes)	The IESO will provide market participants with the reason for rejection, subject to applicable confidentiality restrictions. Market participants may submit a new <i>outage</i> request. Original priority date will be retained if resubmitted within five business days and it was the first time that the <i>outage</i> was rejected (MR Ch. 5 Sec 6.4.17). If these conditions are not met, the resubmitted <i>outage</i> request will receive a new priority date.
	'At Risk'(for <i>outages</i> submitted under the Quarterly Advance Approval Process)	The IESO will provide market participants with the reason for placing the <i>outage</i> 'At Risk', subject to applicable confidentiality restrictions.

		<p>The IESO will review the outage during the next Quarterly, Weekly, 3-Day or 1-Day assessment window, as explained in Section 2.7.2.</p> <p>Market participants may choose to re-submit outages placed 'At Risk.' Refer to Section 2.7.2 for criteria for retaining original priority for re-submitted outage requests.</p>
--	--	---

4.6.2.2 Negotiate to Reschedule

(MR Ch.5 s.6.4.17)

Table 4-5: Possible Next Steps after Negotiate to Reschedule

<u>Possible Next Step</u>	<u>Associated Obligations</u>
<u>Reschedule <i>outage</i> for <i>advance approval</i></u>	<p><u><i>Market participants</i> must reschedule the <i>outage</i> following discussions with the <i>IESO</i>.</u></p> <p><u>The priority date of the original <i>outage</i> request will be retained during resubmission if completed within study time frame.</u></p>
<u>Cancellation</u>	<u><i>Market participants</i> must cancel the <i>outage</i> request in the <i>outage</i> management system.</u>
<u>Rejection (for <i>outages</i> submitted under the <i>Weekly, Three-Day or One-Day Advance Approval</i> processes)</u>	<p><u>The <i>IESO</i> will provide <i>market participants</i> with the reason for rejection, subject to applicable confidentiality restrictions.</u></p> <p><u><i>Market participants</i> may submit a new <i>outage</i> request. Original priority date will be retained if resubmitted within five <i>business days</i> and it was the first time that the <i>outage</i> was rejected (MR Ch.5 s.6.4.17). If these conditions are not met, the resubmitted <i>outage</i> request will receive a new priority date.</u></p>
<u>'At Risk' (for <i>outages</i> submitted under the <i>Quarterly Advance Approval</i> process)</u>	<p><u>The <i>IESO</i> will provide <i>market participants</i> with the reason for placing the <i>outage</i> 'At Risk', subject to applicable confidentiality restrictions.</u></p> <p><u>The <i>IESO</i> will review the <i>outage</i> during the next Quarterly, Weekly, Three-Day or One-Day assessment window, as explained in section 3.7.2.</u></p> <p><u><i>Market participants</i> may choose to resubmit <i>outages</i> placed 'At Risk.'</u></p> <p><u>Refer to section 3.7.2 for criteria for retaining original priority for resubmitted <i>outage</i> requests.</u></p>

4.7 Outage Implementation

(MR Ch.5 s.6.4B.1)

Communication with IESO control room – *Outages* that have received final *advance approval* from the *IESO* can be placed into implementation. *Market participants* are required to notify the *IESO* Control Room to confirm that the *outage* has commenced (~~MR Ch. 5, Sec. 6.4B.1~~) by providing actual start times through *outage* management system, unless otherwise determined by the *IESO*.

Table 4-6: Communication with the IESO Control Room

If...	Then...
After implementation, the <i>market participant</i> wishes to adjust the actual start time of the <i>outage</i>	<ul style="list-style-type: none"> • The <i>market participant</i> must call the <i>IESO</i> Control Room and request that the <i>IESO</i> clears their implementation and must provide the reason for the change. • The <i>IESO</i> will assess the validity of the request and if approved, transition the <i>outage</i> to 'Final Approved' status which will delete the actual start time. • The <i>market participant</i> must input the adjusted actual start time in the <i>outage</i> management system and transition the <i>outage</i> from 'Final Approved' to 'Implemented' status.

4.7.1 Planned and Forced Extensions

(MR Ch.5 s.6.3.4)

Forced extensions to planned outages – *Market participants* have the option of forced extensions, in cases where personnel safety or equipment damage may result. However, forced extensions for planned work will be reviewed for possible violations of the *market rules*. Forced extensions to planned or forced *outages* must be electronically updated in the *outage* management system by *market participants* and communicated via telephone to the *IESO* Control Room. If the forced extension is identified by 15:00 EST, one *business day* prior to the planned end time of the *outage*, *market participants* shall, on a reasonable effort basis, also communicate the forced extension to the *IESO* Market Forecasts & Integration department.

Planned extensions of planned outages – Planned extensions to *planned outages* must be submitted as new *outage* requests.

4.7.2 Recall

(MR Ch.5 s.6.4.11)

Scope, reason, and compensation – Any time during implementation, the *IESO* may recall either the current period or the entire *outage*, based on sudden or unexpected impacts to the *reliability* and/or operability of the *IESO-controlled grid*. The *IESO* will provide affected *market participants* with the reason for the recall. Details regarding *market participant* compensation in cases of *outage* recall are provided in [Section 3.8-section 4.9](#).

Recall as last resort – *Market participants* will be expected to meet the recall times specified in the original submission for the *planned outage*. No *outage* will be recalled unless the *IESO* has revoked or rejected all other *planned outages* that have not yet started and which could eliminate the need to recall the *outage* already in progress (~~MR Ch. 5, Sec. 6.4.11~~).

Replacement energy – *Generation facilities/resources and electricity storage resources* have the option to arrange for replacement *energy* to preclude being recalled. Further details on replacement *energy* are provided in ~~Section 5~~.section 6.

34.7.3 Suspension of Non-Urgent Maintenance or Switching

(MR Ch.5 s.2.5.2)

IESO authority – If the *IESO-controlled grid* is in a *conservative operating state*, the *IESO* may direct *market participants* to suspend any non-urgent maintenance or switching activities.

4.8 Outage Completion

(MR Ch.5 s.6.4A)

Process for returning equipment to service – *Market participants* are required to (~~MR Ch. 5, Sec. 6.4A~~):

- Notify the *IESO* by telephone when either the current period or the entire planned or *forced outage* has been completed;
- Request *IESO* approval by telephone to return equipment to service before doing so;
- Receive *IESO* approval to return the equipment to service. The *IESO* will notify *market participants* at this time if they wish to direct the operation of equipment to return it to service; and
- Notify the *IESO* when equipment that was the subject of a planned or *forced outage* has been fully restored to service by providing actual end times through the *outage* management system, unless otherwise determined by the *IESO*.

Table 4-7: Outage End Time Adjustment

If...	Then...
After completion, the <i>market participant</i> wishes to adjust the actual end time of the <i>outage</i>	<ul style="list-style-type: none"> • The <i>market participant</i> must call the <i>IESO</i> Control Room and request that the <i>IESO</i> clears their completion and must provide the reason for the change.

If...	Then...
	<ul style="list-style-type: none"> • The <i>IESO</i> will assess the validity of the request and if approved, transition the <i>outage</i> to 'Implemented' status which will delete the actual end time. • The <i>market participant</i> must input the adjusted actual end time in the <i>outage</i> management system and transition the <i>outage</i> from 'Implemented' status to 'Completed' status.

4.9 Outage Compensation

~~Generation facilities, electricity storage facilities, distributors and wholesale customers whose planned outages are revoked or recalled by the IESO are entitled to compensation for expenses associated with the revocation or recall, subject to the following conditions (MR Ch. 5, Sec. 6.7.2):~~

- ~~• the outage was originally provided advance approval by the IESO;~~
- ~~• the outage was recalled or had advance approval revoked because of a material error in the IESO's demand forecast, a failure of generation facilities or electricity storage facilities within the IESO control area, a failure of facilities forming part of the IESO controlled grid, or a failure of interconnection facilities, and~~
- ~~• the out-of-pocket expenses exceed \$1,000.00.~~

~~Under the market rules, only (MR Ch.5 s.6.7)~~

~~**Governing authority – MR Ch.5 s.6.7** governs eligibility for compensation for revoked or recalled outages.~~

~~**Eligible expenses – Only** out-of-pocket costs are eligible for compensation under MR Ch.5 s.6.7.2 of the *market rules*. These are sunk costs that are unrecoverable and will be incurred again by *market participants* in order to complete the *outage*. Items such as overtime costs and equipment rentals are eligible.~~

~~Market participants, whose Quarterly, Weekly or 3-Day Advance Approval for a planned outage on a generation facility or electricity storage facility is initially granted **Study and** then revoked by **coverage periods** – The below subsections set out examples showing how the IESO, will not be eligible for compensation if (apply MR Ch. 5, Sec. s.6.7.3A):~~


- ~~• The IESO revoked the advance approval due to a forced outage of another generation facility or electricity storage facility with the same registered market participant as the generation facility or electricity storage facility that submitted the planned outage request and the forced outage occurred before 16:00 EST three business days prior to the scheduled start of the planned outage, or~~

- ~~The IESO revoked the advance approval due to delayed return to service from a planned or forced outage of another generation facility or electricity storage facility with the same registered market participant as the generation facility or electricity storage facility that submitted the planned outage request, or~~

~~A planned outage is granted Quarterly Advance Approval and scheduled to start in the last three months of a six-month coverage period, and the IESO revokes the Quarterly Advance Approval before the end of the next quarterly study period and coverage periods.~~

4.9.1 Example A: Market participant ~~Participant~~ NOT entitled to ~~Entitled to~~ compensation

As ~~shown~~ displayed in Figure 3-1 below 4-2, the outage is scheduled for May and receives ~~Quarterly Advance Approval~~ quarterly advance approval in November. The IESO revokes quarterly approval in January. In this case, the market participant is not entitled to compensation because the revocation is done before the next

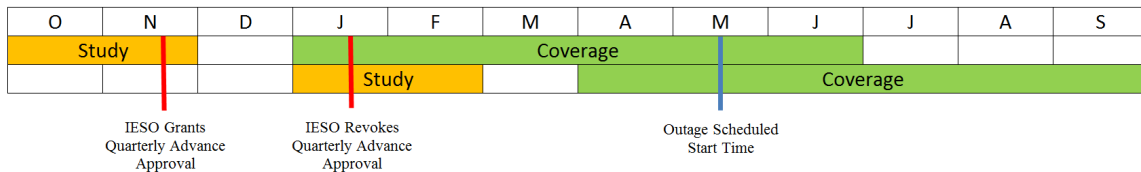

quarterly study period ends in February.


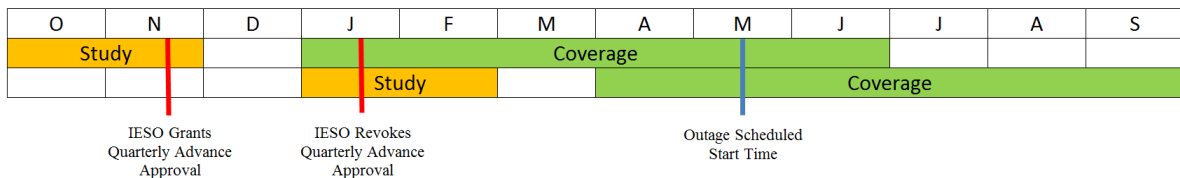


Figure 3-1:4-1: Compensation Eligibility – Example A

4.9.2 Example B: Market participant ~~Participant~~ entitled to compensation

In this example, the outage is scheduled for May and the IESO revokes ~~Quarterly Advance Approval~~ quarterly advance approval in March (i.e. after the next quarterly study period ends in February). Therefore, the market participant is entitled to

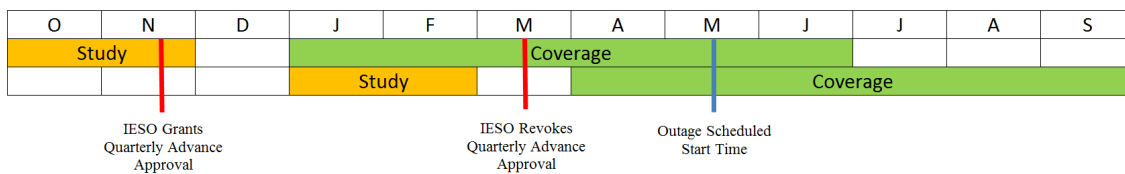

compensation.

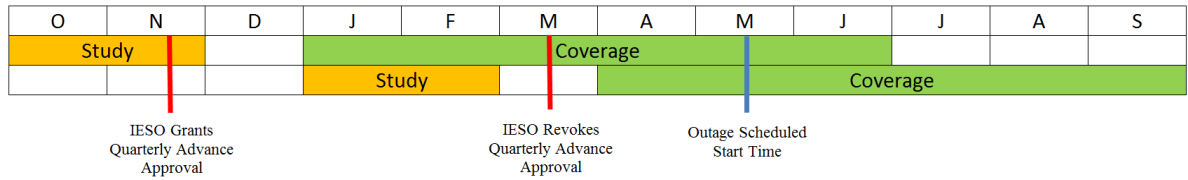


Figure 3-2:4-2: Compensation Eligibility – Example B

4.9.3 Example C: Market participant entitled to compensation

In this example, the *outage* is scheduled to start in March which is within the first three months of the quarterly coverage period, therefore even though the *IESO* revokes the *outage* before the end of the next quarterly study period in February, the *market participant* is entitled to compensation.

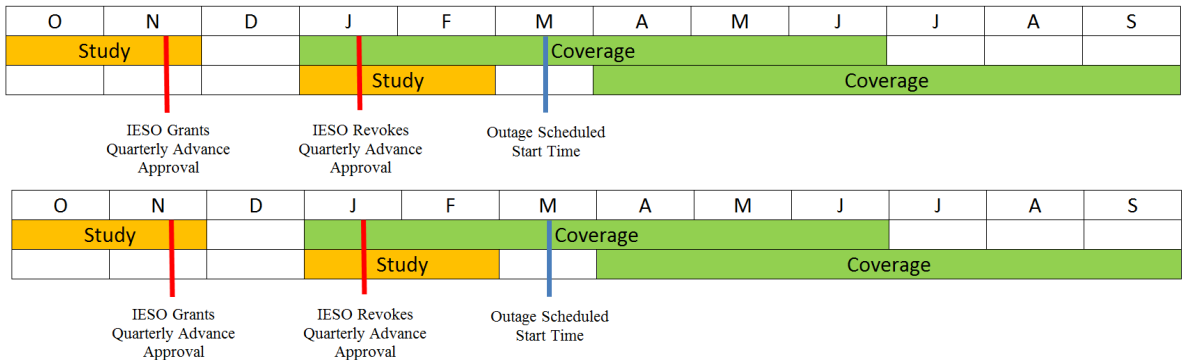


Figure 3-3:4-3: Compensation Eligibility – Example C

Opportunity costs excluded – *Generation facilities* or *electricity storage facilities* whose *planned outages* have *advance approval* revoked or are recalled **are eligible for compensation** even though they had successfully arranged for replacement energy, ~~are eligible for compensation~~. However, the *generation facility* or *electricity storage facility* will not be eligible for compensation for any lost opportunity costs associated with the import *energy* that was secured through the arranged replacement *energy*.

Submission – Claims for compensation must be submitted using the “Request for Outage Compensation” ([IMO FORM 1350](#)) that is available on the ~~IESO’s website~~ (See [Appendix A](#)), ~~IESO website~~, and substantiated by receipts or statements detailing each line item. These claims will be subject to audit and verification by the *IESO*.

~~Transmitters are not entitled to compensation for any costs, losses or damages associated with the revocation or recall of a planned outage (MR Ch. 5, Sec. 6.7.1). Each act of revocation or recall by the IESO shall be treated separately for compensation purposes (MR Ch. 5, Sec. 6.7.7).~~

- End of Section -

35 Outage Reporting Requirements

This ~~Section 4~~section outlines *outage* reporting requirements that are specific to certain classes of *market participants* when submitting *outage* requests to the *IESO*, unless granted *exemption*. Each sub-section provides sample ~~Priority,~~ ~~Purpose~~priority, ~~purpose~~ and ~~Constraint Codes~~constraint codes that *market participants* may use when submitting *outage* requests via the *outage* management system. For detailed description of these codes, refer to ~~Sections 2.2, 2.3, and 2.4.~~ Refer to ~~Section 2.6~~sections 4.2, 4.3 and 4.4. Refer to section 4.6 for a mapping of these codes.

Note: The rules for submission, approval and determining priority as per *market rules* are applicable for all *outage* requests.

5.1 Generation Facilities and Electricity Storage Facilities

(MR Ch.5 ss.3.6.1 and 3.8.1)

Scope of obligation – Aggregated *generation facilities*~~resources~~ and *electricity storage facilities*~~resources~~ are required to report *forced outages*, unit limitations, deratings, de-staffing and any change in status that affects the maximum output of a *generation unit*, ~~or~~ *electricity storage unit*, the minimum load of a *generation unit*, or the availability of a *generation unit* or *electricity storage unit* to provide *ancillary services* such as *regulation*, *operating reserve*, voltage support, *black start capability* or must-run contracts (~~MR Ch. 5, Sec. 3.6.1 and 3.8.1~~).

Storage – All other *outage* requests related to the *electricity storage facility's*~~resource's~~ injection capability should follow the applicable *generation unit* permissions and requirements outlined in this *market manual*.

An *electricity storage facility*~~resource~~ wishing to report its inability to withdraw must update its *dispatch data* accordingly and submit *outage* requests as follows:

Table 5-1: Example Codes for Electricity Storage Resources when Unable to Withdraw

Priority Code	Constraint Code	Purpose Code
Planned	DERATEDRATE	Repair

Note: This section is intended for the reporting of all *outages* with the exception of *state of charge* capability changes in real-time; for such changes ~~see Market~~

~~Manual refer to MM 4.2–1: Submission of Dispatch Data in the Real-Time Energy and Operating Reserve Physical Markets.~~

~~For electricity storage facilities wishing to undergo testing, see Section 45.1.2.~~

1 Deratings

(MR Ch.5 ss.3.6.1 and 3.8.1; MR Ch.7 s.3.3.8)

Reporting requirements – All *generation facility resource* and *electricity storage facility* deratings, including those resulting from *generation facility or electricity storage facility start-up or shutdown, resource* are required to report outages in the following circumstances:

- ~~Any~~ planned or forced material reduction in *generation facility resource* or *electricity storage facility resource* output that causes a derating equal to the greater of 2% of rated output or 10 MW;
- A component failure, operational limit or other circumstance that will cause the unit to trip if no control actions can be taken before the condition can be repaired as assessed by the *generation facility or electricity storage facility*; and; or
- A new potential change in unit/plant condition that can cause the loss of multiple units at its *facility* based on its internal assessment/forecast.

Process for ramping down – A *generation facility or electricity storage facility* wishing to ramp down for a *planned outage* is required to follow either of the following methods:

- ~~Submit~~ and get approval for a *planned outage* request. The *generation facility resource* or *electricity storage facility resource* will be ramped down at the submitted ramp rate in advance of the hour in which the *outage* commences; or
- ~~Submit~~ derate requests electronically to reflect the capability of the *generation facility resource* or *electricity storage facility resource* as it ramps down.

Loading delays – Normal loading delays during a *generation facility or electricity storage facility* start-up are not considered a derating if the *generation facility resource* or *electricity storage facility resource* is able to ramp towards full load without significant holds. Where a *generation facility resource* or *electricity storage facility resource* must hold at a specific load for greater than 30 minutes during start-up, this should be considered a derating. The IESO will assess planned deratings required to support a *generation facility resource* or *electricity storage facility resource* ramp down or start-up on a reasonable effort basis.

~~If fossil generation facilities having known start-up delays are scheduled by pre-dispatch within a timeframe that does not accommodate the start-up delay, market participants are required to cancel their offers for the hours in which their units are unavailable. Within the restricted and mandatory windows, the IESO Control Room shall allow these offers to be removed.~~

Pseudo-units – Combined cycle generation facilities that elect to offer in to the market as a pseudo-unit (PSU) will submit derates and outages on the associated generation units.

Revising dispatch data for short-term outages and derates – A generation facility resource or electricity storage facility resource whose outage or derating results in a change of more than the lesser of 2% of rated output or 10 MW₇ is not required to revise their offers pursuant to MR Ch.7 s.3.3.8 if the derating or outage is expected to last less than two hours. Where their offer the market participant had been altered the offer to reflect the capability of their resource, the IESO will permit a quantity change or new offer will be allowed by the IESO. This change should reflect the capability of the resource in the pre-dispatch schedule. Changes to offers in the mandatory and restricted window will not affect the current hour.

Submission – Market participants are required to use the DRATE or MUSTRUN Constraint Code constraint code when submitting outage requests, Table 4-15-2 provides an example:

Table 4-15-2: Example Codes ~~When~~ Submitting Planned Derate Requests

Priority Code	Constraint Code	Purpose Code
Planned	DRATE	Maintenance

5.1.2 Tests

(MR Ch.5 s.6.6.7; MR Ch.7 ss.2.2A and 2.2D)

Process – Generation facilities and electricity storage facilities may request approval for an Opportunity outage to conduct tests during a planned or forced outage. In order for the outage requests and tests to not have conflicting time spans in the outage management system, the following procedure should be followed:

1. Revise the end time of the original outage request to coincide with the start of the first test.
2. Ensure the first test request has a start time that corresponds to the end time of the outage in the revised outage request.

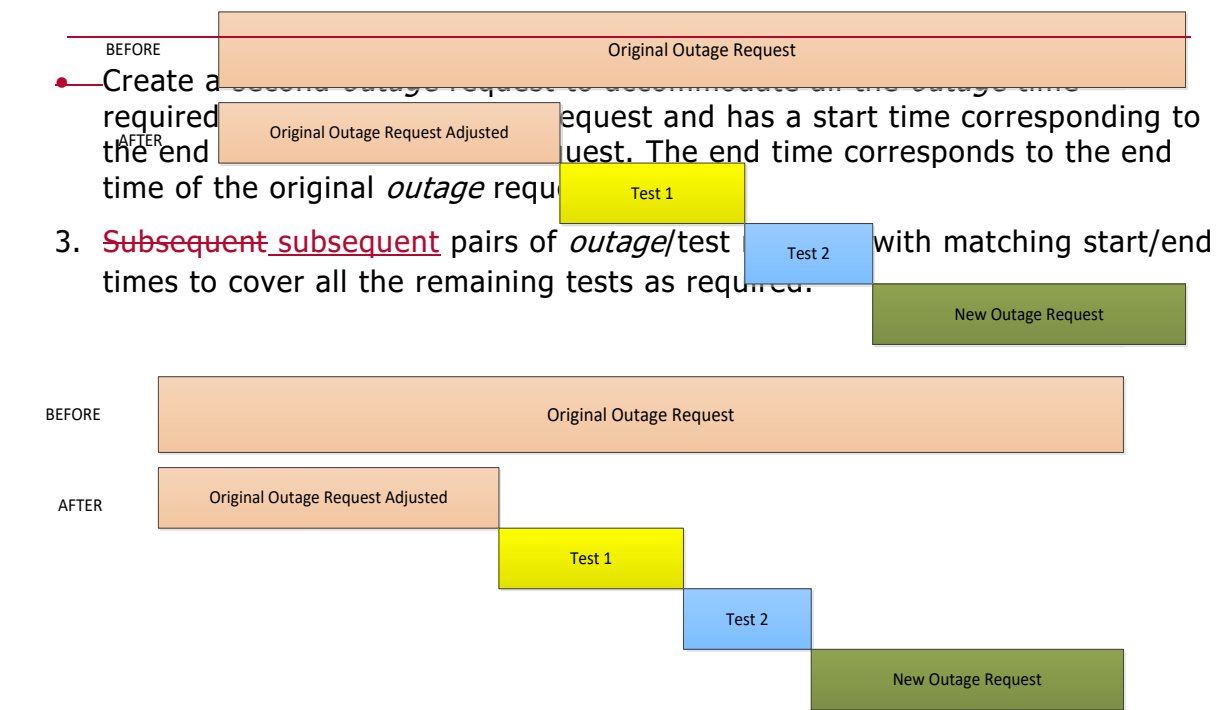


Figure 4-1:5-1: Submitting Test Request during Outage

Treatment as commissioning facility – Where testing is extensive and is expected to continue for a minimum of two days, *market participants* may request that the *IESO* treat the *generation facility* or *electricity storage facility* as a *commissioning generation facility* or *commissioning electricity storage facility* (**MR Ch.-7, Sec. ss.2.2A and 2.2D** respectively). Requests to be treated as a *commissioning generation facility* or *commissioning electricity storage facility* should be made to the *IESO* through the *outage* process and to **FacilityEquipment** Registration. Requests of this nature should be made with a minimum of six *business days'* notice. See Section 4.1.3 Refer to section 5.1.3 for reporting details.

Hydroelectric resources within a compliance aggregate – For tests of hydroelectric *generation facilities* within a compliance aggregate, *market participants* must submit a test profile as part of the *outage* request. The aggregate will be *offered* to reflect the aggregate output during testing. The aggregate total generation will be maintained at the *offer/dispatch* level as the test *generation facility* loads or unloads.

Offers on aggregated resources – *Market participants* having aggregate units with one of the units being tested would *offer*, ensuring that the associated price is appropriate to be scheduled, the maximum achievable output for the aggregate, excluding the testing unit and compensate for testing by adjusting units within the aggregate. Non-aggregated *generation facilities* and non-aggregated *electricity storage facilities* are required to *offer* the full capability of the **facilityresource** and use *outage* requests to derate the **facilityresource** to the appropriate test level (**MR Ch.-5, Sec. s.6.6.7**).

Suspension and reloading – Often *generation facility* and *electricity storage facility* tests are conducted where the test can be suspended and the *generation facility resource* or *electricity storage facility resource* is then capable of ~~re-~~ **reloading**. These tests are treated differently than *generation facility resource* and *electricity storage facility resource* deratings in that no *outage* for a derating is required, however *market participants* are required to submit an *outage* request in accordance with the submission deadlines outlined in [Section 2.7 section 3.7 of this market manual](#) indicating the planned test quantities as described in the example below.

Offer price – For any hour in which a *market participant’s generation facility* or *electricity storage facility* is expected to undergo a test, *market participants* must submit an economical *offer* for the generation/injection that equals the expected hourly average *energy* delivery of that unit.

Example:

Table 5-3: Offer Price Test Example

If expected generation is...	Then the offer submitted for the hour will be...
250 MW for 20 minutes, 175 MW for 10 minutes, and 135 MW for 30 minutes	= 180 MW at an offer price that would ensure $\frac{250 \times 20 + 175 \times 10 + 135 \times 30}{60}$ = 180 MW at an offer price that would ensure the unit is scheduled to deliver 180 MW

IESO intervention – However, since the unit is testing, it would not move to the *dispatch* target, and the *IESO* operator may have to intervene to adjust for the behaviour of the testing unit.

Storage – *Electricity storage facilities* wishing to undergo capability testing must submit an *outage* request outlining the test plan with respect to injection and withdrawal operations. The *IESO* shall review and coordinate real-time testing requirements including appropriate *dispatch data* submissions for the injection and withdrawal operation during testing.

Operating reserve market participation – Where the test is instantly recallable, *generation facilities* and *electricity storage facilities* are allowed to participate in the *operating reserve market*. This is acceptable as long as the *market participant offers*

$$(\text{maximum energy expected to be provided during the hour}) - (\text{operating reserve quantity offered during the hour}) = (\text{maximum amount that the unit can provide that hour})$$

$$\text{(maximum energy expected to be provided during the hour) + (operating reserve quantity offered during the hour) = (maximum amount that the unit can provide that hour)}$$

Using the example above:

Table 5-4: Operating Reserve Market Participation Example

If...	The offer submitted for the hour will be...
Maximum generation per hour is 450 MW	<p>200 to 270 MW of energy at a higher price.</p> <hr/> <p>450 MW (maximum output during the hour) - 250 MW (maximum loading during the hour) = 200 MW of operating reserve at a price of the market participant's choosing</p> <p>180 MW at a price to ensure that unit is scheduled</p> <p>200 to 270 MW of energy at a higher price.</p>

This *energy offer* would be scheduled if *operating reserve* is activated or if there are a shortage of *resources* that required the *energy* (at which time, the *market participant* would be expected to abandon the test to meet their *operating reserve dispatch*).

No eligibility for compensation – *Generation facilities* and *electricity storage facilities* whose test *outages* are immediately recallable and participate in the *operating reserve market* are not expected to submit for compensation costs. Rather, it is expected that *offers* for *energy* and *operating reserve* will reflect any compensation for interrupting the test.

Aggregate resources – For tests of aggregate *generation facilities/resources* and *electricity storage facilities/resources* with immediate recall, *market participants* must provide a test profile via an information request to the *IESO*. *Market participants* must offer the aggregate as per the *energy* they desire to run but would adjust loading of units within the aggregate to obtain the required test levels. *Market participants* must request approval to synchronize and desynchronize the test unit, but may change the test unit **MW/MWs** as desired while maintaining the aggregate **MW/MWs** as offered.

Purpose codes – *Market participants* are required to use the **Testing Purpose Code 'Testing' purpose code** when submitting *outage* requests, Table 4-25-5 provides an example:

Table 4-2-5-5: Example Codes ~~When~~ Submitting Planned Testing Requests

Priority Code	Constraint Code	Purpose Code
Planned	IS	Testing

5.1.3 Commissioning Facilities

(MR Ch.7 ss.2.2A, 2.2A.5, 2.2D, 2.2D.5 and 2.3.2)

Treatment as commissioning facility – A *commissioning generation facility* or a *commissioning electricity storage facility* shall be treated as, respectively, a *self-scheduling generation facility* or a *self-scheduling electricity storage facility* for the purposes of *outage* coordination and shall follow the normal *outage* scheduling process (~~MR Ch. 7, Sec. ss. 2.2A~~ and ~~2.2D~~). The *commissioning generation facility* or *commissioning electricity storage facility* shall provide a detailed test plan including the following information, but not limited to:

- ~~The~~the expected time of synchronizing to or ~~de-synchronizing~~desynchronizing from the *IESO-controlled grid*_{*i*};
- ~~Energy~~energy and reactive output levels_{*i*};
- ~~The~~the timing of and ramp rates associated with changes in *energy* and reactive output levels_{*i*};
- ~~Run~~run-back or trip tests for the *commissioning generation facility* or *commissioning electricity storage facility*_{*i*} and
- ~~Excitation~~excitation and ~~Power System Stabilizer~~power system stabilizer (PSS) tests.

Flexibility and loading profile – The *IESO* will attempt to provide scheduling flexibility for *commissioning generation facilities* and *commissioning electricity storage facilities* in the same manner as those *generation facilities* or *electricity storage facilities* performing routine testing as per ~~Section~~section 45.1.2. *Market participants*, whose *generation units* or *electricity storage units* with *planned outages* are returning to service from long-term *outages*, or are *commissioning generation units* or *commissioning electricity storage units*, shall provide the *IESO* with a loading profile before synchronization.

Security and adequacy assessments – The treatment of *self-scheduling generation facilities* and *self-scheduling electricity storage facilities* in the *IESO's* security and *adequacy* assessments depends on the type of commissioning being performed as follows:

1. New *generation facilities* and *electricity storage facilities*, or those returning from long-term *outages* (mothballing) that are registered as *self-scheduling generation facilities* or *self-scheduling electricity storage facilities*, will be

treated as unavailable for the purpose of calculating available capacity in the *IESO's adequacy* assessments.

- A *planned outage* request should be submitted by *market participants* that define first synchronization and the expected date of commercial operation.
 - *Market participants*, who ~~are do~~ not have *variable generation facilities, resources* should submit, and keep up to date, the expected commissioning schedule (either via an *outage* request or other format as specified by the *IESO*) for the duration of the commissioning period.
 - *Market participants*, who ~~are have~~ have *variable generation facilities resources*, must submit, and keep up to date, the expected commissioning schedule via an *outage* request for the duration of the commissioning period.
 - *Commissioning generation facilities* or *commissioning electricity storage facilities* that ~~are do~~ not have *variable generation facilities resources* should manage all commissioning activities, until commercial operation is declared, with the use of *dispatch data* as a *self-scheduling generation facility* or *self-scheduling electricity storage facility*. *Dispatch data* should reflect the most recent update to the commissioning schedule.
 - *Commissioning generation facilities*, that ~~are have~~ have *variable generation facilities resources* shall offer a forecast output as provided by the *IESO*.
2. *Generation facilities* that are registered as *self-scheduling generation facilities* or *self-scheduling electricity storage facilities* for the purpose of testing new or modified equipment associated with the *generation facility* or *electricity storage facility* will be treated as available for the purposes of calculating available capacity in the *IESO's adequacy* assessments. In addition,
- A *planned outage* request should be submitted by *market participants* that define the commissioning period.
 - While commissioning, *market participants*, who ~~are do~~ not have *variable generation facilities resources*, must manage their loading by the use of *dispatch data* as a *self-scheduling generation facility* or *self-scheduling electricity storage facility*. *Market participants*, who ~~are have~~ have *variable generation facilities resources*, must manage their loading via *outage* requests and offer a forecast output, as provided by the *IESO*.
 - *Outage* requests are to be submitted for each stage of the commissioning period that reflects expected output.

Advance notice – For *generation facilities* and *electricity storage facilities* beginning commissioning, the *IESO* requires at least three ~~months~~ months' advance

notice of the expected synchronization date (~~MR Ch. 7, Sec. ss. 2.2A.5 and 2.2D.5~~). This date may be revised by *market participants* as required.

Submitting dispatch data – For the purpose of submitting *dispatch data*, the *commissioning generation facility* or *commissioning electricity storage facility* shall apply to register as a *self-scheduling generation facility* or *self-scheduling electricity storage facility* and comply with applicable *market rules*, in order to submit the necessary *dispatch data* for testing. Requests to be registered as a *self-scheduling generation facility* or *self-scheduling electricity storage facility* should be made to the IESO within a minimum of six *business days'* notice (~~MR Ch. 7, Sec. ss. 2.2A and 2.2D~~). Any such registration for the purposes of commissioning tests shall expire on the completion of these tests, at which time registration as a *generation facility* or *electricity storage facility* is required to participate in the *real-time markets*.

Aggregate resources – Where the *generation facility* or *electricity storage facility* undergoing commissioning testing, forms part of ~~an~~ **aggregate**, the whole aggregate will be treated as *self-scheduling generation facility*. The IESO may not approve these requests where the loss of *operating reserve* from the aggregate causes a *reliability* concern (~~MR Ch. 7, Sec. s. 2.3.2~~).

Deviations from submitted quantity – In the event that the *commissioning generation facility* or *commissioning electricity storage facility* intends to increase its output above its *self-schedule dispatch data* for any reason, the *offers* should be updated outside the mandatory window. If the *commissioning generation facility* or *commissioning electricity storage facility* is unable to achieve the *self-schedule offer* for any reason, the *offers* should be updated as soon as possible. An *outage* request should also be submitted to reflect the reduced capability from the *self-scheduled* quantity.

Purpose codes – *Market participants* are required to use the **Commissioning Purpose Code** 'Commissioning' purpose code when submitting *outage* requests, Table ~~4-35-6~~ provides an example:

Table 4-3+Table 5-6: Example Codes for Commissioning Generation Facilities and Commissioning Electricity Storage Facilities

Priority Code	Constraint Code	Purpose Code
Planned	IS	Commissioning

5.1.4 Segregated Mode of Operation

~~Outage requests to operate generation facilities (MR Ch. 7 App. 7.7 s. 1.3)~~

Two different timelines – There are two sets of timing requirements for operating units in *segregated mode of operation* (SMO). The difference depends on whether an outage to a critical transmission element is required.

Classification of requests – The IESO will consider Requests for segregation as opportunity outages unless requested based on the one-day advance approval criteria. To meet the one-day advance criteria, SMO must be requested by 10:00 EST two business days ahead of the dispatch day. The Planned Start and End Date/Time must be on the same calendar date or the Maximum Recall on the outage is 15 minutes.

5.1.4.1 SMO Requiring Operation of a Critical Transmission Element

Timing of requests – Requests for segregation that require an outage to a critical transmission element must be included in the day-ahead market and submitted by 08:00 EPT on the 1-Day Advance Approval deadline, unless otherwise agreed day prior to by the dispatch day. The IESO. Along with submitting an will approve or reject the outage request, market participants are also required to no later than 10:00 EPT on the day prior to the dispatch day.

Timing and availability of cancellation or revision – Market participants may only cancel or revise requests for segregation that require an outage to a critical transmission element after 08:00 EPT to address a situation that may endanger the safety of any person, damage equipment, or violate any applicable law (SEAL).

Reconfiguration – Where a request for segregation will require transmission system elements to be reconfigured or removed from service, the IESO will notify the IESO by telephone of the request being submitted transmitter and enter an outage request in the outage management system to reflect this reconfiguration for the duration required to support the Request for Segregation.

The IESO must approve them, by telephone or the outage management system, no later than 10:00 EST, one business day prior to the SMO start date to ensure inclusion in first run of Day Ahead Commitment Process (DACP).

DACP related processes for generation facilities operating in SMO are detailed in Market Manual 9.2: Submitting Operational and Market Data for the DACP.

~~Market participants may submit SMO~~ 5.1.4.2 SMO Not Requiring Operation of a Critical Transmission Element

Timing of requests ~~as opportunity outages,~~ Requests for segregation that do not require an outage to a critical transmission element may be submitted up to two hours prior to the start of the outage. Market participants who intend to have this request scheduled in the day-ahead market must submit their request no later than 09:00 EPT on the day prior to the dispatch day. The IESO will approve or reject the outage requests no later than 90 minutes prior to the implementation of the segregated mode of operation.

Timing and availability of cancellation and revision – Requests for segregation that do not require an outage to a critical transmission element can be

cancelled at any time by the *market participant* and do not require conditions related to the safety of any person, damage to equipment, or violation of any applicable law (SEAL).

Submission process – *Market participants use the outage process to submit Requests for Segregation. The IESO will approve or reject these requests based on security and adequacy impact assessments.*

Notification by telephone – *Along with submitting an outage request for the facilities that are intended to operate in segregated mode, market participants are required to notify the IESO by phone of the request for segregation. The IESO will assess any requests for segregation according to the expected resource adequacy and approved according to the outcome.*

Timing of IESO decision – *For generator requests for segregation or desegregation, the IESO will provide permission to the market participant to proceed, or reject the request, as soon as possible but not later than such time that allows the transmitter a minimum of 90 minutes to switch the equipment or facilities required to permit the implementation of the SMO.*

Reconfiguration – *Where a request for segregation will require transmission system elements to be reconfigured or removed from service, the IESO will enter an outage request in the outage management system to reflect this reconfiguration. The outage will be entered for the duration required to support the request for segregation.*

No compensation – *Where a previously approved segregation request is revoked or segregation is terminated, no outage compensation will apply.*

Required steps - When submitting a request for operation in segregated mode, *generation facilities* must:

- Submit an *outage* request for their units for the duration of the segregated mode.
- Submit a second *outage* request for the time required to ramp down the units to zero (to be submitted within the hour prior to the start of the first *dispatch hour* to which the segregated request pertains).
- Maintain the *offers* for their *generation facilities/resources* for each *dispatch hour* in which these *facilities/resources* will or are intended to operate in *segregated mode of operation*¹⁴.
- Notify the IESO by phone that the Request for Segregation was submitted (MR ~~Ch.7~~ App. ~~7.7~~, Sec. ~~7~~ s. ~~1.3.5~~).

¹⁴The submission of the *outage* request will fulfill the obligations with respect to the submission of *dispatch data* as set out in MR, ~~CH~~ ~~Ch.7~~, App. ~~7.7~~.

~~Where a Request for Segregation will require transmission system elements to be reconfigured or removed from service, the IESO will notify the transmitter and enter an outage request in the outage management system to reflect this reconfiguration for the duration required to support the Request for Segregation.~~

Returning from segregation – When units are returning from *segregated mode of operation*, *generation facilities* must ensure:

- The *outage* for their units ends at the same time the units are to be reconnected to the *IESO-controlled grid*.
- Valid *offers* are in the *IESO* systems for these units, for the hour they will be returning from *segregated mode of operation*. When submitting their *offers*, *generation facilities* must respect the short notice submission criteria as specified in the *market rules*.
- If necessary, to zero their revenue meter while in *segregated mode of operation* in order to be removed from the *IESO's* settlements process.
- Notify the *IESO* by phone of the request for ~~de-segregation~~desegregation (MR Ch.7 App.-7, Sec. ~~ss.1.3.3~~, and 1.3.4).

Purpose codes – *Market participants* are required to use the 'Segregated Mode of Operation Purpose Code' Operation' purpose code when submitting *outage* requests, Table 4-45-7 provides an example:

~~Table 4-4:~~**Table 5-7: Example Codes When Requesting Planned Segregated Mode of Operation**

Priority Code	Constraint Code	Purpose Code
Planned	OOS	Segregated Mode of Operation (SMO)

~~1.2.1 [Intentionally Left Blank]~~

5.2 Loads

5.2.1 Dispatchable Loads

~~Dispatchable loads are required to submit information requests in the event of planned outages or tests that result in demand reduction of 20 MW or more relative to the average weekday demand of the facility. During an outage, loads are expected to consume according to their bid quantity. Upon change of plan, loads are expected to update bid and offer data and notify the IESO.~~

(MR Ch.5 s.3.5.1)

Required submissions – Any ~~planned or~~ *outages, forced outages, restrictions, deratings or changes in configuration of power system auxiliaries and transmission facilities* operated at 50 kV or higher that form part of, or are, connected to the *IESO-controlled grid* and which affect the operation of the *dispatchable load*, must be submitted to the *IESO*. These *outages* shall be coordinated and submitted by the owner of the *facility* required to be on *outage*. For *outages* to the transmission element to which the *dispatchable load* is connected, the *transmitter* will apply for the *outage* and coordinate with the customer.

Example – Table 4-5-8 provides example codes for *dispatchable loads* when submitting *planned outage* requests:

Table 4-5-8: Example Codes for Planned Outages to Dispatchable Loads

Priority Code	Constraint Code	Purpose Code
Planned	DERATEDRATE	Repair

5.2.2 Connected Wholesale Customers

~~Wholesale(MR Ch.5 s.3.5.1)~~

Informational purposes – ~~For *wholesale customers* are required to notify the *IESO* in the event of changes that result in reduction of 20 MW or more from the average weekday *demand* or supply. This requirement applies, for example, to large industrial customers that periodically shut down their plants for maintenance, holidays, etc.~~

~~Wholesale customers that~~ are required to submit information about the planned shutdown in advance, ~~however,~~ approval from the *IESO* is not required, ~~as~~ the *outage* is supplied for ~~information~~ informational purposes only.

Priority, constraint, and purpose codes – *Market participants* are required to use the codes in Table 4-6-9 when submitting *outage* requests:

Table 4-6-9: Applicable Codes for Wholesale Customers

Priority Code	Constraint Code	Purpose Code
Information	INFO	Other

5.2.3 Distributors and Transmitters

~~Under the *market rules*, *distributors* are required to notify the *IESO* in the event of changes that result in change(MR Ch.5 ss.3.4.1, 3.7.1 and 10.2.3)~~

Application – ~~For greater than 20 MW from the average weekday *demand* or supply. This requirement applies to~~ clarity, the outage reporting obligations under

MR Ch.5 s.3.7.1 include *distributors* with embedded loads or generation that are not registered with the *IESO* (*MR Ch. 5, Sec. 3.4.1, 3.5.2, and 3.7.1*).

~~*Distributors and transmitters are also required to notify the IESO in advance of demand control actions. Demand control actions include: demand management, voltage reductions and disconnections.*~~

~~In the event of plans **Direct communication for demand** control actions, *market participants* are required to submit *outage* information to the *IESO* by 10:00 EST each day, for the following day. Any *emergency* plans subsequent to this deadline must be submitted immediately.~~

The following information is required:

- ~~Proposed date, time, and duration of the cuts by *connection point* on the *IESO* controlled grid, by hour, and~~
- ~~Proposed MW reduction of *demand* by *connection point* on the *IESO* controlled grid, by hour.~~

management – The actual decrease in MW reduction of *demand* achieved through any *demand* control actions must be communicated directly to the *IESO* Control Room, by telephone at the time that the reduction is implemented.

Example – Table ~~4-75-10~~ provides example codes for *distributors* and *transmitters* when submitting *planned outage* requests:

Table 4-7: Table 5-10: Example Codes for Distributors and Transmitters

Priority Code	Constraint Code	Purpose Code
Planned	OOS	Switching

5.2.4 Outages and Non-Performance Event Management for Capacity Auction Resources

~~This sub-section outlines *outage* management requirements for *capacity auction resources* with *capacity obligations*.~~

5.2.4.1 Dispatchable Capacity Auction Resources (including Capacity Imports)

~~(MR Ch.7 ss.19.5.5, 19.5.6, 19.7.5, 19.7.6, 19.9.5, 19.9B5, 19.9B.6, 19.11.5 and 19.11.6)~~

Priority, constraint, and purpose codes – *Demand response resources* are required to use the codes in Table 5-11 when submitting *outage* requests:

Table 5-11: Applicable Codes for Demand Response Resources

<u>Priority Code</u>	<u>Constraint Code</u>	<u>Purpose Code</u>
<u>Information</u>	<u>INFO</u>	<u>Other</u>

5.2.4.2 Non-Performance Event Management for Hourly Demand Response Resources

(MR Ch.7 ss.19.4.9 – 19.4.10)

HDR Resources with a Capacity Obligation Acquired through the Capacity Auction

Record requirements – Capacity market participants with an hourly demand response (HDR) resource that has a capacity obligation ~~is~~are required to maintain records of all reductions to demand response capacity of 5 MW or greater during an obligation period. The IESO may request the records for a period of ~~1~~one year from the end of the associated commitment period. If requested, these records must be provided to the IESO by email by the deadline defined by the IESO. The records must contain the following details:

- ~~Description~~description of ~~Event~~event
- ~~Resource~~resource name
- ~~Trade Date~~
- ~~Hour~~trade date
- hours of reduced capacity
- ~~Registered~~registered capacity of the HDR resource
- ~~Amount~~amount of reduction (MW) to demand response capacity
- ~~action~~Action taken to manage energy bid

Notice to IESO – For any quantity, capacity market participants whose HDR resources received an activation report with an activation notice on the dispatch day are required to notify the IESO Control Room by telephone as soon as practical if they are unable to provide their activation amount.

Timing of dispatch data revisions – Capacity market participants are required to update bids for HDR resources pursuant to **MR Ch.7 s.19.4.10** for any reduction to demand response capacity occurring on the ~~pre~~-day prior to the dispatch day or dispatch day to reflect the reduced demand response capacity.

5.3 All Market Participants

(MR Ch.5 ss.3.2.1 and 3.4.1)

Reliability of individual customer connections – As per *market rules* and the *operating agreements* between *transmitters* and the *IESO*, the IESO's outage assessments will not include assessments of impacts to the *reliability* of individual customer connections. Assessing the *reliability* of individual customer connections is the role of the *transmitter*, who is required to:

- ~~Coordinate~~coordinate *outages* impacting customer connections; and
- ~~Recommend~~recommend changes to transmission configuration and or recall or cancel *outages* to secure the supply to customer connections during a *high-risk operating state* or a conservative operating state.

5.3.1 Monitoring and Control Equipment

~~Market participants are required to report planned and forced outages to monitoring and control equipment, data concentrating facilities that aggregate monitoring and control information from more than one facility.~~

~~For forced outages, market participants are required to respond and restore these facilities to a fully operational state within the time frames specified by Chapter 4, Section 7.7 of the market rules. Based on the impact of the equipment's unavailability on the reliability and/or operability of the IESO controlled grid, the IESO may notify market participants to respond within a longer or shorter period that those specified in Sections 7.7.2 and 7.7.3 of the market rules, provided that, where the time to respond and restore is less than 24 hours, the market participant will use commercially reasonable efforts to achieve such direction (MR Ch. 4, Sec. 7.7.4).~~

Table 4-8(MR Ch.4 ss.7.7.1 – 7.7.4)

Example – Table 5-12 provides example codes for *market participants* when submitting *planned outage* requests to monitoring and control equipment:

Table 4-8;5-12: Example Codes for Planned Outages to Monitoring and Control Equipment

Priority Code	Constraint Code	Purpose Code
Planned	OOS	Other

5.3.2 System Tests

~~Power system tests typically involve abnormal configurations of the power system, extensive coordination during work, or unusual precautions to ensure the reliability~~

~~and/or operability of the IESO-controlled grid. Tests covered by these requirements include, but are not limited to (MR Ch. 5, Sec. 6.6):~~

- ~~• The deliberate application of short circuits,~~
- ~~• Generation unit, electricity storage unit, and transmission system stability tests,~~
- ~~• Planned actions which cause abnormal voltage, frequency or overloads,~~
- ~~• Planned abnormal station or system setups with inherent risk, and~~
- ~~• Tests of equipment for which there is some real or potential risk of widespread impact on the IESO-controlled grid.~~

~~In order to gain approval for the test, market participants arranging the test must submit the following details (MR Ch. 5, Sec. 6.6.2):~~

- ~~• Equipment involved,~~
- ~~• The relevant details of contracts or agreements as they relate to the test activities,~~
- ~~• Preferred and alternative dates and times for the conduct of the test activities,~~
- ~~• Unusual system conditions or setup required,~~
- ~~• Any required changes in setup, power flow, voltage, frequency, etc., that could have an impact on the reliability and/or operability of the IESO-controlled grid,~~
- ~~• Details of special readings, observations, etc., to be recorded by operating personnel, and~~
- ~~• Identity of personnel who are directly involved in the test, their location and the means of communicating with them.~~

~~The IESO will approve the outage request if it is determined that the test will not have an adverse effect on the reliability and/or operability of the IESO-controlled grid or on the operation of the IESO-administered markets.~~

~~(MR Ch.5 s.6.6)~~

Test coordinator – Where required, arrangements shall be made for a Test Coordinator to be appointed. The name and role of the Test Coordinator shall be specified in the *outage* submission. The duties of the Test Coordinator include:

- ~~Defer~~defer, limit, or stop the System Test due to unfavorable system conditions or test results~~;~~
- ~~Monitor~~monitor test conditions in the area involved~~;~~ and
- ~~Act~~act as a communicator, and other roles as agreed upon in the *outage* submission.

Additional outages included in submission – If the *outage* submission involves additional *outages* or safety code procedures, the requestor shall ensure that *outage* requests are submitted by the appropriate *market participant(s)*.

Exclusions – Examples of requirements that will not be considered power system tests and should be arranged in the normal manner for *outages* include:

- ~~Routineroutine~~ generation unit and *electricity storage unit* rejections~~;~~
- ~~Routineroutine~~ protection and control maintenance and testing~~;~~
- ~~Routineroutine~~ commissioning tests~~;~~ and
- Work or testing on hydraulic waterways and storage.

Purpose codes – *Market participants* are required to use the ~~Testing Purpose Code~~ *Testing purpose code* when submitting *outage* requests, ~~Table 4-9~~ Table 5-13 provides an example:

~~Table 4-9~~ Table 5-13: **Example Codes When Submitting Planned System Test Requests**

Priority Code	Constraint Code	Purpose Code
Planned	IS	Testing

5.3.3 Testing of Ancillary Services

~~The IESO shall test facilities that intend to, or do, provide ancillary services to the IESO-controlled grid.~~

~~**Note:** During such testing, the IESO may submit outage requests on behalf of market participants. These will only be visible to the IESO and used for informational purposes.~~

~~(MR Ch.4 App.4.2; MR Ch.5 s.4.9)~~

Timing and scheduling – Tests must be successfully completed prior to entering into a *contracted ancillary services* contract, for a *facility resource* providing *regulation* or black start services, and at least annually thereafter throughout the contract period. Tests shall be arranged and scheduled at a time mutually agreeable to both the *ancillary service provider* and the *IESO* in accordance with the *outage* scheduling processes outlined in this *market manual*.

~~For contracted providers of the Reactive Support and Voltage Control Service the IESO may require tests in accordance with MR Ch. 5, Sec. 4.9.~~

Standards and procedures – Performance standards and testing procedures are prescribed in the “*IESO – Ancillary Service Provider (ASP) Agreements for Procurement of Certified Black Start Facilities*”~~”.~~ Schedule 2 of this Agreement stipulates the required black start performance standards, with Schedule 3 articulating the required testing procedures. MR Ch.4 App.4.2 governs performance standards for contracted reactive support and voltage control.

~~The performance standards for contracted reactive support and voltage control are stipulated in MR Ch. 5.3.4, App 4.2.~~

Testing Operating Reserve Providers

~~The IESO may conduct unannounced tests of any market participant's facility registered to provide operating reserve and currently scheduled to provide operating reserve.~~

~~**Note:** During such testing, the IESO may submit outage requests on behalf of market participants. These will only be visible to the IESO and used for informational purposes.~~

~~(MR Ch.5 ss.4.9 – 4.10)~~

Test assessment – The IESO will assess market participants' compliance with ~~the~~ test operating reserve dispatch instruction issued in accordance with MR Ch.5 s.4.9.2 according to the ~~respective~~relevant operating reserve offer submission data. For the purposes of this manual, a failure to meet an operating reserve target during an operating reserve activation (ORA) will also be deemed as a test failure.

Special requirements and coordination – If *dispatchable load facilities* providing operating reserve identify special testing requirements, the IESO will coordinate testing within the first week of the *market participant's* acceptance in the market as an operating reserve provider, or as soon as possible. Subsequent testing will occur on a periodic basis.

~~Tests shall be arranged in accordance with MR Ch. 5, Sec. 4.9 and 4.10.~~

Reserve Unannounced tests – *Operating reserve* testing is the responsibility of the IESO and is conducted by the control room operators (CROs). The CROs will implement unannounced tests pursuant to MR Ch.5 s.4.9.2 taking into account any ~~facilities~~resources with poor past performance that require additional testing.

~~If~~**Aggregated resources** – If *operating reserve* testing is implemented on a *resource* that is part of an aggregate, compliance will be assessed on the output of the aggregate.

Note: If there is non-compliance to actual reserve activations, the following approach will be used with respect to removing offers.

Table 4-10: Table 5-14: Implementing and Assessing Reserve Tests

If a market participant...	The IESO will...
Fails an initial reserve test or an ORA, (i.e., fails to meet <i>dispatch</i> target within prescribed time [10 or 30 minutes])	<ol style="list-style-type: none"> 1. 1. (At <i>IESO</i> discretion)¹⁵ direct the <i>market participant</i> to remove its reserve <i>offers</i> on the <i>resource</i> for the remainder of that day and the next day. 2. 2. Allow these changes within the two-hour mandatory window. 3. 3. Retest the unit, normally within a week after it submits reserve <i>offers</i> again.
Fails their first retest of the reserve test or an ORA, (i.e., fails to meet <i>dispatch</i> target within prescribed time [10 or 30 minutes])	<ol style="list-style-type: none"> 1. 1. Direct the <i>market participant</i> to remove its reserve <i>offers</i> on the <i>resource</i> for one week. 2. 2. Allow these changes within the two-hour mandatory window. 3. 3. Retest the unit, normally within a week after it submits reserve <i>offers</i> again.
Fails their second retest of the reserve test or an ORA, (i.e., fails to meet <i>dispatch</i> target within prescribed time [10 or 30 minutes])	<ol style="list-style-type: none"> 1. 1. Direct the <i>market participant</i> to remove its reserve <i>offers</i> on the <i>resource</i> indefinitely. 2. 2. Allow these changes within the two-hour mandatory window. 3. 3. Initiate follow-up with the involved <i>market participant</i>. As a result of this follow-up, a decision will be made as to whether the <i>facility</i> should be removed from the reserve market, and the circumstances for allowing the return to the reserve market.
<ul style="list-style-type: none"> • Fails a reserve test because of an unforeseen forced <i>outage</i> or equipment limitation, and • Is NOT a <i>dispatchable load</i> 	Request the <i>market participant</i> to submit an <i>outage</i> to derate or force the equipment out-of-service.

¹⁵ Discretion may be applied in determining whether or not to direct a *market participant* to remove its reserve *offers* after a failed activation. The following may be taken into consideration:

- System conditions may exist where available *operating reserve* is particularly limited (e.g., freshet, tight supply conditions). Removal of reserve *offers* may lead to potential shortfall.
- A *resource* that failed to meet the reserve target within the required time may have faced legitimate circumstances that led to the failed activation. If these circumstances have been, or are expected to be rectified, then future activation of reserve is expected to be met without failure.

If a market participant...	The IESO will...
<ul style="list-style-type: none"> • Fails a reserve test because of an unforeseen forced <i>outage</i> or equipment limitation, and • Is a <i>dispatchable load</i> 	<ol style="list-style-type: none"> 1. 1. Request the <i>market participant</i> to change its <i>energy bid</i> to reflect the derate or force the equipment out-of-service. 2. 2. Request the <i>dispatchable load</i> to remove its reserve <i>offers</i>, as the DSO cannot handle derates on <i>dispatchable loads</i>. 3. 3. (Once the <i>forced outage</i> condition has been repaired) allow the <i>market participant</i> to resubmit its reserve <i>offers</i> within the two-hour mandatory window.

5.3.5 Hold-offs

(MR Ch.5 ss.3.4.1.3 – 3.4.1.4)

Definition – Hold-offs are restrictions in the use of transmission lines to facilitate maintenance activities. Automatic reclosure is blocked and manual reclosure is restricted until contact is made with the hold-off party. Single and multiple element hold-offs may be granted Auto AA or FAA.

Constraint codes – *Market participants* are required to use the ~~HOLDOFF~~ Constraint Code 'HOLDOFF' constraint code when submitting *outage* requests, ~~Table 4-11~~Table 5-15 provides an example:

~~Table 4-11~~Table 5-15: Example Codes When Submitting Planned Hold-off Requests

Priority Code	Constraint Code	Purpose Code
Planned	HOLDOFF	Other

5.3.6 New and Replacement Facilities

(MR Ch.5 s.6.4A)

Submission prior to energization or return to service – *Market participants* are required to report an *outage* prior to ~~(MR Ch. 5, Sec. 6.4A):~~:

- Energization of any new *facility*, ~~or~~:
- Energization of any new *facility resource* equipment ~~impactive on~~ *may impact* the *reliability* and/or operability of the *IESO-controlled grid*; ~~or~~
- Returning into service replacements of any existing *facility* equipment *impactive on* the *reliability* and/or operability of the *IESO-controlled grid*.

Not eligible for one-day advance approval – *Outage* submissions ~~that request~~requesting the energization of new *facilities* are not eligible to be requested for the ~~1-Day~~One-day Advance Approval process, as the ~~impact of introducing a new facility cannot be adequately assessed by the IESO within the timelines of the 1-Day Advance Approval~~this process do not allow for the IESO to adequately assess the impact of the new facilities. In addition, *market participants* must ensure that all applicable *facility* registration requirements are complete, prior to the commencement of any such *outage*.

~~Table 4-12~~**Example codes** – ~~Table 5-16~~ provides example codes for *market participants* when submitting *planned outage* requests to new and replacement ~~facilities~~resources:

Table ~~4-12~~5-16: Example Codes When Requesting Planned Outages to New and Replacement ~~Facilities~~Resources

Priority Code	Constraint Code	Purpose Code
Planned	MUSTRUN	Replacement

– End of Section –

46 Replacement Energy to Support Planned Outages

~~A generation facility or electricity storage facility may notify the IESO that it will arrange replacement energy offers in the form of an import to support a planned outage request or when requesting an extension to an outage. Such a notification does not obligate the generation facility or electricity storage facility to notify the IESO, and if so notified, the IESO to approve or accept any such arrangement. The generation facility or electricity storage facility may withdraw the arrangement for replacement energy offers at any time up to final approval of the outage or up to the final approval of the extension (MR Ch. 5, Sec. 6.3.6).~~

~~(MR Ch.3 s.6.6.10A; MR Ch.5 ss.6.3.6 and 6.3.9; MR Ch.7 ss.7.5.8A – 7.5.8B)~~

Criteria for determining the minimum quantity – Where, based on the IESO's assessment of *security* and *adequacy*, the IESO permits the *generation facility* or *electricity storage facility* to arrange for replacement *energy*, the IESO shall determine the minimum MW amount to be arranged as replacement *energy* ~~(pursuant to MR Ch. 5, Sec. s.6.3.9)~~ based on the following:

- The MW amount of replacement *energy* shall be no less than the forecast shortfall from the *Adequacy* Report as determined prior to *advance approval* being provided or based on more current information in the *Adequacy* Report;
- Where the shortfall occurs beyond the period of 14 days, the IESO will identify the weeks of shortfall and the maximum amount to be arranged for these weeks based on the ~~dayDay~~ 15 to 34 *Adequacy* Reports or the *Reliability Outlook* report prior to *advance approval* being provided. The *generation facility* or *electricity storage facility* should wait until the shortfall is detailed in an *Adequacy* Report covering the ~~dayDay~~ 0 to 14 period, to identify the specific shortfall hours and amounts to finalize the amount of replacement *energy*. In any case, replacement *energy* must be finalized by the *generation facility* or *electricity storage facility* no later than 16:00 EST three *business days* prior to the commencement of the shortfall week(s); and
- Shall not exceed the amount of *energy* that was agreed to at the time of finalization or 500 MW.

Submission process and required information – *Generation facilities* and *electricity storage facilities* shall convey to the IESO their arrangement for replacement *energy* by way of the comments field in the *outage* management system with the following information:

- ~~The~~the *intertie* where *offers* will be submitted;~~;~~;
- ~~A~~A unique identifier associated with the e-Tag or a unique e-Tag ID~~;~~;
- ~~The~~the MW amount to be *offered* and the duration of the *offers* (if finalized), and the *registered market participant* associated with a *registered facility* that is a *boundary entity* resource that shall submit the *offers*.

Day-ahead market submission and compliance enforcement – Once the *IESO* has approved or provided additional direction to the *generation facility* or *electricity storage facility* specifying the details of the replacement *energy import offers*, the *generation facility* or *electricity storage facility* whose *outage* was approved is obligated to ensure that these *offers* are submitted to the *IESO* for ~~pre-dispatch scheduling~~the day-ahead market. The *boundary entity* resource who shall provide replacement *energy* and that is subject to *dispatch instructions* received from the *IESO*, is subject to the failed *intertie* transaction rules in **MR Ch.-7, Sec. ss.7.5.8A and 7.5.8B and MR Ch.-3, Sec. s.6.6.10A to 6.6.10C** and the ~~related~~any compliance guidelines and enforcement.

Intertie scheduling – The *IESO* may specify the *intertie(s)* where the replacement *energy* is to be scheduled in order to meet *reliability* requirements.

~~The~~**Criteria for determining duration of offers** – Pursuant to **MR Ch.5 s.6.3.9**, the *IESO* shall ~~have the right to specify~~determine the duration of *offers* necessary to support the *outage request* (~~MR Ch. 5, Sec. 6.3.9~~). ~~The IESO shall make this determination~~ based on the following:

- ~~Reliability~~reliability and/or operability impacts on the *IESO-controlled grid*;~~;~~;
- ~~Forecast~~forecast capabilities of the *interconnections* for the duration of the *planned outage*;~~;~~; and
- ~~Forecast~~forecast *adequacy* of neighbouring jurisdictions for the duration of the *planned outage*.

Submission requirements – The duration that replacement *energy offers* to be submitted to the *IESO* as part of the *pre-dispatch scheduling process* shall be:

- ~~No~~no less than the period of the shortfall hours applied to each day of the week(s)¹⁶ of the shortfall~~;~~; and
- ~~No~~no greater than the total duration of the *outage*.

Example – For example,

¹⁶ For the purposes of *outage replacement energy*, week is defined as weekdays (Monday to Friday excluding holidays). Where shortfalls occur on a weekend or holiday, the *IESO* will identify this requirement to the *generation facility* or *electricity storage facility* and the *generation facility* or *electricity storage facility* will be required to arrange for replacement *energy* to cover these shortfalls.

A generation facility or electricity storage facility ~~makes a request for~~ requests a 300 MW outage over three weeks. A shortfall of 100 MW is identified on the Tuesday of the second week between 9:00 AM to 10:00 AM EST. The IESO will notify the market participant of the shortfall and reject the outage.

In order to get approval for the outage request, the market participant must agree to arrange for replacement energy from 9:00 AM to 10:00 AM EST (shortfall hours) for all days of the second week.

However, the market participant may wait until 16:00 EST three business days prior to the commencement of the second week of the outage, to finalize the amount and hours of replacement energy. By waiting to finalize the amount, the generation facility or electricity storage facility accepts that the purchase amount may increase from the amount forecast when the outage was given advance approval.

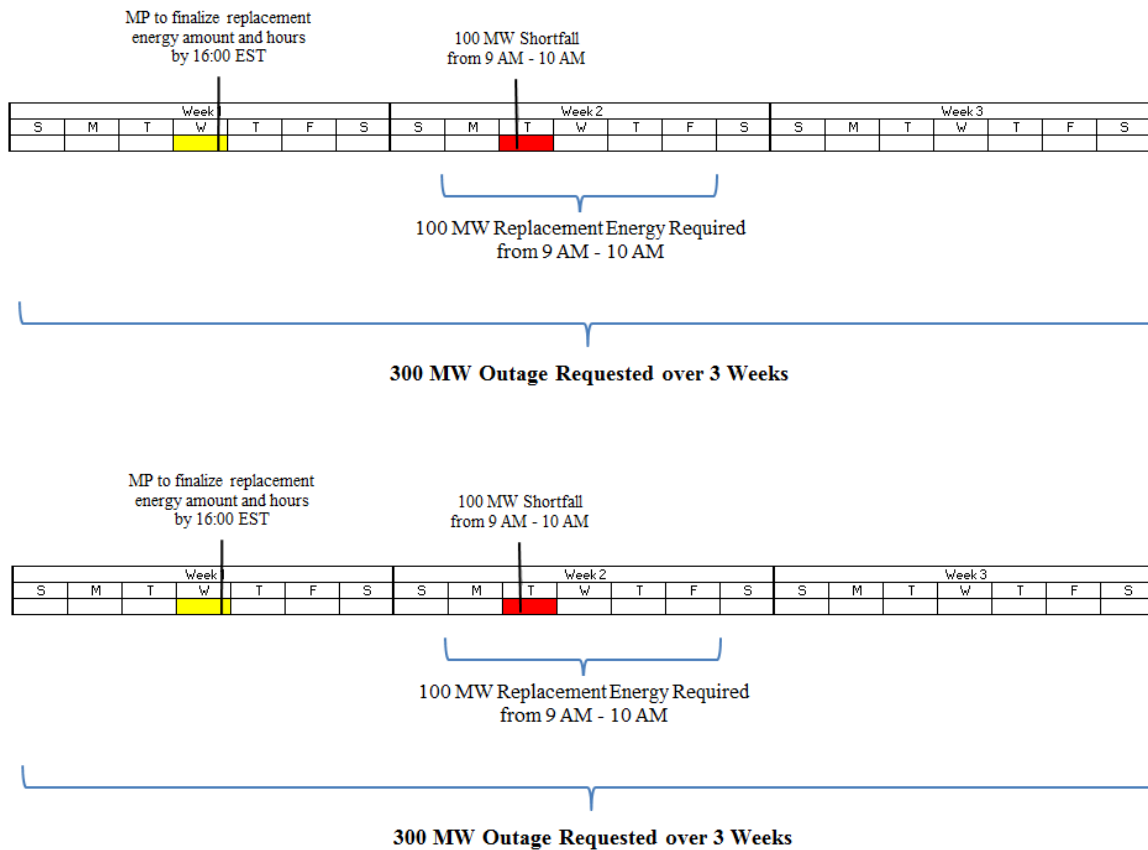


Figure 5-1+6-1: Purchase of Replacement Energy – Requirements and Confirmation Timeline

For example,

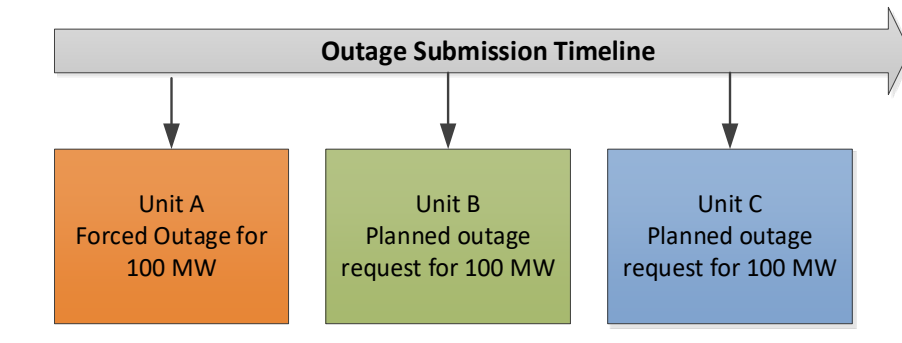


Figure 6-2: Outage Submission Timeline Example

Figure 6-2 depicts the submission timeline of three *outages* creating a shortfall totalling 300 MW. Unit B and Unit C are offered the opportunity to purchase replacement *energy*.

Table 6-1: Replacement Energy Purchase

If...		Then...
		<p>Unit B and Unit C are offered the opportunity to purchase replacement <i>energy</i>.</p>
Unit B chooses to purchase replacement <i>energy</i>		<ul style="list-style-type: none"> Unit B is required to purchase 200 MW, to clear shortfall caused by <i>forced outage</i> plus its <i>outage</i>. Unit C is required to purchase 100 MW
Unit B does chooses not choose to purchase replacement <i>energy</i>		<ul style="list-style-type: none"> <i>Outage</i> to Unit B is rejected. Shortfall is reduced to 200 MW Unit C is required to purchase 200 MW, to clear shortfall caused by <i>forced outage</i> plus its <i>outage</i>.

Priority assessment – *Generation facilities* and *electricity storage facilities* that have arranged replacement *energy* to support their *planned outage* are assessed based on priority according to the following:

- When requesting *outage* approvals during periods of *adequacy* concerns, *generation facilities* or *electricity storage facilities* who have arranged for replacement *energy* to support a *planned outage* will have a higher priority than *outages* that have chosen not to arrange replacement *energy* (and would otherwise be rejected).

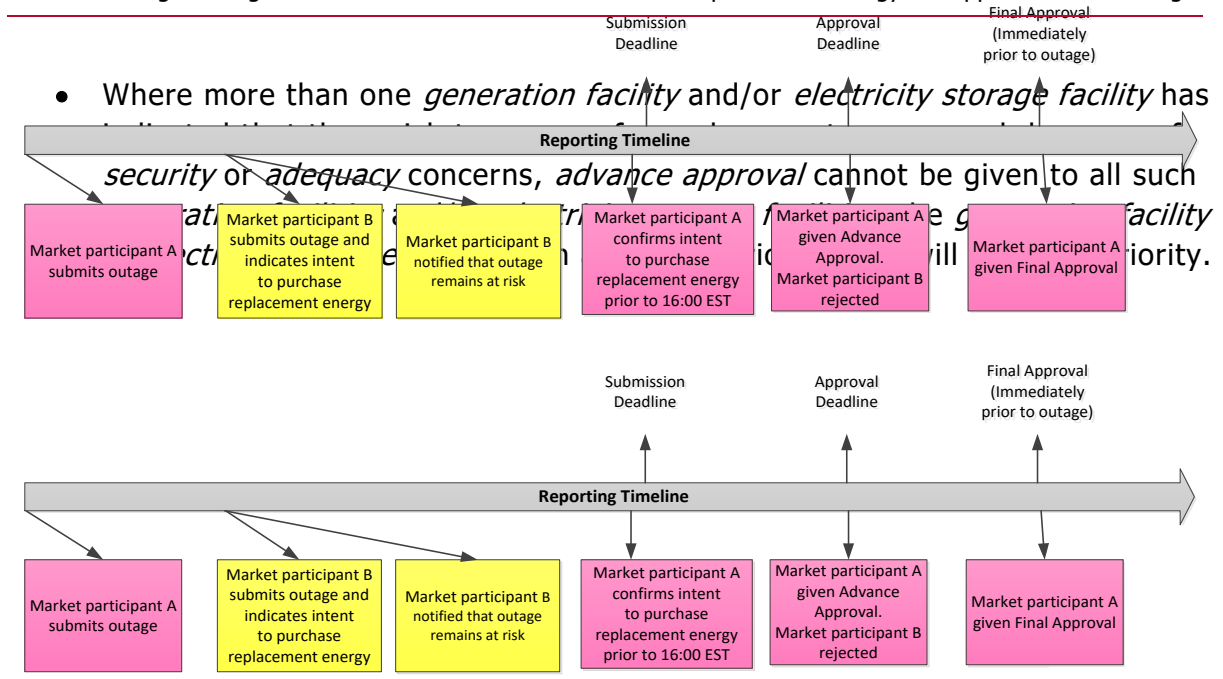


Figure 5-2:6-3: Precedence of Outages Based on Purchase of Replacement Energy

- Where a *generation facility* or *electricity storage facility* is identified to be at risk after the replacement *energy* confirmation timeline but before the *advance approval* timeline as detailed in [Section 2.7, section 3.7](#), and then confirms the intent to arrange replacement *energy* before the *advance approval* timeline, the *generation facility* or *electricity storage facility* shall maintain its priority date relative to *outages* that confirmed replacement *energy* before the confirmation timeline.
- Where a *generation facility* has to be revoked or recalled due to *energy* shortfalls identified after the *advance approval* or final approval was granted, precedence will be given based on the priority date, regardless of whether the approval is based on arranging replacement *energy*.
- Where a *generation facility* or *electricity storage facility* indicates that they intend to arrange for replacement *energy* and they do not have priority date precedence over other *generation facilities* or *electricity storage facilities* who may elect to arrange for replacement *energy* they will be notified that they may not be eligible. A final decision regarding eligibility cannot be made until the *outage* submission deadline. In this situation, it would be prudent for *market participants* without priority date precedence to wait until the submission deadline before arranging replacement *energy*.

– End of Section –

~~Disputes and Compliance~~

~~1.3 Disputes~~

7 Dispute Resolution

(MR Ch.3 s.2)

Application of dispute resolution process to outage management decisions

~~—~~ The *IESO* or an Applicant may initiate the Dispute Resolution process in accordance with **MR Ch. 3, Sec. s.2** if either believes the circumstances warrant such action. Specifically, *market participants* may dispute any decision of the *IESO* related to *outage* management, such as rejection of an *outage* submission, revocation or recall of an approved *outage*, or denial of *outage* compensation.

~~However, market~~

No stay of obligations pending decision – Market participants must continue to follow the direction of the *IESO* until such time as the Dispute Resolution panel renders a decision. ~~For more information regarding the dispute resolution process, refer to Market Manual 2.1: Dispute Resolution.~~

~~1.4 Market Surveillance and Compliance~~

~~A Market Surveillance Panel was established pursuant to the “Electricity Act, 1998” for the purpose of identifying inappropriate market conduct, market design flaws and to make sure that the *IESO* administered market is fair and efficient. *IESO* staff may forward potential non-compliant actions of *market participants* to the *IESO* Market Assessment and Compliance division. Refer to Market Manual 2.6: Treatment of Compliance Issues and Market Manual 2.7: Treatment of Market Surveillance Issues for more information regarding the dispute resolution process.~~

~~—End of Section—~~

~~Appendix A: Forms~~

~~The following form is used in connection with the *outage* management process. This form is available to *market participants* on the *IESO* website:~~

Form Name	Form Number
Request for Outage Compensation	IMO_FORM_1350

End of Appendix –

Appendix A: Outage Reporting Requirements

Outages must be coordinated with the *IESO* and reported to the *IESO* when, for any of the following *facility* group elements:

Transmission systems¹⁷ operated at voltages of 100 kV or more:

- All element *outages* must be reported to the *IESO*.

Transmission systems operated at voltages less than 100 kV:

- Removal of step-down transformers with a low-side voltage less than 100 kV
- Involve the unloading of step-down transformers or their individual windings¹⁸
- Require paralleling or separation of buses via operation of bus tie breaker
- Result in a load transfer of 20 MW or greater between step-down transformer stations
- Adversely affect a *generation facility* or *dispatchable load* or *electricity storage facility*

Transmission or distribution reactive elements:

- 15 MVAR or greater in areas electrically south of Essa TS in Barrie
- 10 MVAR or greater in areas electrically north of Essa TS in Barrie
- Synchronous Condensers and Static VAR Compensators (SVCs)

Power system auxiliaries¹⁹:

- Control systems designed to dynamically respond to system conditions in such as:

¹⁷ *Facilities* that form part of or are connected to the *IESO-controlled grid* and used for the purpose of transmitting or distributing electricity. These *facilities* may be owned by a *transmitter, wholesale customer, distributor or generator*.

¹⁸ Where multiple *facilities* involve logic that require those *facilities* be operated together (i.e., both a switch and a breaker are arranged in series and the switch cannot be operated without first opening the breaker), it is only necessary to report on one of those *facilities*.

¹⁹ The following power system auxiliaries are excluded from *outage* reporting:

- Switchyard auxiliaries that do not affect, or the loss of an additional element that does not affect, the operation of the *IESO-controlled grid* or the operation or capability of components of the *IESO-controlled grid*.

- Power system stabilizers (PSSs)
 - Automatic voltage regulation (AVR)
 - Operating aids such as:
 - Circuit auto-reclosure schemes
 - Voltage reduction *facilities*
 - Underfrequency load shedding (ULFS) *facilities*
 - Primary or backup protection systems designed to detect and isolate failed or faulted elements
 - Breaker failure protection
 - Breaker trip coil test
 - *Remedial action schemes (RAS)* that detect identified system conditions and take corrective action such as:
 - *Combined generation facility, or electricity storage facility, load rejection schemes*
 - Reactor tripping schemes
 - Communication *facilities* such as:
 - SCADA
 - RTUs, ICCC links or telemetry *facilities* for display of quantities
 - *Market participant dispatch tools and facilities*
 - Communication *facilities* such as voice, data and protection tone communications
 - Switchyard auxiliaries such as:
 - AC and DC station services
 - Supervisory control *facilities* or Control Room bench-boards
 - Multi-breaker air supply systems including compressor plants and cable cooling systems
-
- Step-down transformer station low voltage bus protections and low voltage reactive *resource* protections (capacitors), unless they cause unavailability of the component and/or a reconfiguration of the *IESO-controlled grid*.
 - Feeder protections and feeder breaker auto-reclosures, unless they create a load transfer during system tests, or restrict access to the *IESO-administered markets* of embedded *facilities*.

Non-registered facilities or non-registered embedded facilities²⁰:

- Result in a change of more than 20 MW in *demand* or supply in an hour from what is typical for that hour (i.e. large industrial customers that periodically shut down plants for maintenance or holidays)

Dispatchable load resources/ Wholesale customers:

- Result in changes of more than 20 MW in *demand* or supply in an hour from what is typical for that hour.

Distributors and transmitters:

- Result in changes of more than 20 MW in *demand* or supply in an hour from what is typical for that hour.
- Demand control actions, including *demand* management, voltage reductions and disconnections.

Generation resources or electricity storage units:

- All *generation resources* or *electricity storage units*
- *Segregated mode of operation (SMO)*
- Available but not operating (ABNO)
- Deratings:
 - derating equal to the greater 2% of rated output or 10 MW
 - holds at a specific *load* for >30 minutes during start-up
- Affects the maximum output or minimum *load* of a *generation unit* or *electricity storage unit*
- A component failure, operational limit or other circumstance that will cause the unit to trip
- Plant auxiliaries that affect more than a single *generation resource* or *electricity storage unit*, or aggregate of *generation resources* or *electricity storage units* where the loss of an additional element results in multiple unit/aggregate shutdowns within 48 hours such as:
 - service air or instrument air
 - boiler feed pumps
 - station service

²⁰ If the *facility* is not registered with the IESO, this responsibility falls on the *market participants* (i.e. *transmission customers* for the *facility*).

- Affects the availability to provide *ancillary services* such as:
 - automatic generation control (AGC)
 - voltage support
 - black start service

Testing:

- All tests described in section 5.3.2: System Tests
- Testing of *generation units* or *electricity storage units*, including:
 - in-service or commissioning tests
 - testing of derated units at levels above the following table are met: derated levels

Table B-1: ~~Outage Reporting Requirements~~

Facility Group	Elements of the Facility Group for which Outages must be Reported
Transmission facilities²¹ operated at voltages ≥ 100 kV	All
Transmission facilities operated at voltages < 100 kV	 <ul style="list-style-type: none"> • Removal of step-down transformers with a low side voltage < 100 kV • Involve the unloading of step-down transformers or their individual windings²² • Require paralleling or separation of buses via operation of bus tie breaker • Result in a load transfer ≥ 20 MW between step-down transformer stations • Adversely affect a <i>generation facility, dispatchable load</i> or <i>electricity storage facility</i>
Transmission or Distribution Reactive resources	 <ul style="list-style-type: none"> • 15 MVAR or greater in areas electronically south of Essa TS in Barrie • 10 MVAR or greater in areas electronically north of Essa TS in Barrie

²¹ Facilities that form part of or are connected to the *IESO-controlled grid* and used for the purpose of transmitting or distributing electricity. These facilities may be owned by a transmitter, *wholesale customer*, distributor or generator.

²² Where multiple facilities involve logic that require those facilities be operated together (i.e., both a switch and a breaker are arranged in series and the switch cannot be operated without first opening the breaker), it is only necessary to report on one of those facilities.

Facility Group	Elements of the Facility Group for which Outages must be Reported
	• Synchronous Condensers and Static VAR Compensators (SVC's)

Facility Group	Elements of the Facility Group for which Outages must be Reported
<p>Power system auxiliaries²³</p>	<p>Control Systems designed to dynamically respond to system conditions such as:</p> <ul style="list-style-type: none"> • Power System stabilizers (PSSs) • Automatic voltage regulation (AVR)
	<p>Operating aids such as:</p> <ul style="list-style-type: none"> • Circuit auto-reclosure schemes • Voltage reduction facilities • Under frequency load shedding (ULFS) facilities
	<p>Primary or backup protection systems designed to detect and isolate failed or faulted elements</p>
	<p>Breaker failure Protection</p>
	<p>Breaker Trip Coil Test</p>
	<p>Special Protection Systems (SPS) that detect identified system conditions and take corrective actions such as:</p> <ul style="list-style-type: none"> • Combined generation facility, or <i>electricity storage facility</i>, and load rejection schemes • Reactor tripping schemes
	<p>Communication facilities such as:</p> <ul style="list-style-type: none"> • SCADA • RTU's, ICCP links or telemetry facilities for display or quantities • Market participant dispatch tools and facilities
	<p>Switchyard auxiliaries such as:</p> <ul style="list-style-type: none"> • AC and DC <i>station services</i> • Supervisory control facilities or Control Room bench-boards • Multi-Breaker air supply systems including compressor plants and cable cooling systems
<p>Non-registered facilities or embedded facilities²⁴</p>	<p>Result in a change of more than 20 MW in <i>demand</i> or supply in an hour from what is typical for that hour (i.e. large industrial customers that periodically shut-down plants for maintenance or holidays)</p>

²³The following power system auxiliaries are excluded from *outage* reporting:

- ~~• Switchyard auxiliaries that do not affect, or the loss of an additional element that does not affect, the operation of the IESO-controlled grid or the operation or capability of components of the IESO-controlled grid.~~
- ~~• Step-down transformer station low voltage bus protections and low voltage reactive resource protections (capacitors), unless they cause unavailability of the component and/or a reconfiguration of the IESO-controlled grid.~~
- ~~• Feeder protections and feeder breaker auto-reclosures, unless they create a load transfer during system tests, or restrict access to the IESO-administered markets of embedded facilities.~~

²⁴If the facility is not registered with the IESO, this responsibility falls on the *market participants* (i.e. *transmission customers* for the facility).

Facility Group	Elements of the Facility Group for which Outages must be Reported
Dispatchable load facilities/ Wholesale customers	Result in changes of more than 20 MW in demand or supply in an hour from what is typical for that hour.
Distributors and Transmitters	Result in changes of more than 20 MW in demand or supply in an hour from what is typical for that hour. Demand control actions, including demand management, voltage reductions and disconnections.
Generation Facilities or electricity storage facilities	All generation units or electricity storage units
	Segregated Mode of Operation (SMO)
	Available but not operating
	Deratings:
	<ul style="list-style-type: none"> ● Derating equal to the greater 2% of rated output or 10 MW ● Holds at a specific load for >30 minutes during start up
	Affects the maximum output or minimum load of a generation unit or electricity storage unit
	A component failure, operational limit or other circumstance that will cause the unit to trip
	Plant auxiliaries that affect more than a single generation unit or electricity storage unit , or aggregate of generation units or electricity storage units where the loss of an additional element results in multiple unit/aggregate shutdowns within 48 hours such as: <ul style="list-style-type: none"> ● Service air or instrument air ● Boiler feed pumps ● Station Service
Affects the availability to provide ancillary services such as: <ul style="list-style-type: none"> ● Automatic Generation Control (AGC) ● Voltage support ● Black start service 	
Testing	All tests described in Section 4.3.2: System Tests
	Testing of generation unit or electricity storage units , including: <ul style="list-style-type: none"> ● In service or commissioning tests ● Testing of derated units at levels above the derated levels ● Testing of units currently on outage ● Tests of facilities providing ancillary services
All Equipment	Hold-off
	Energization: <ul style="list-style-type: none"> ● Energization of any new facility, or

Facility Group	Elements of the Facility Group for which Outages must be Reported
	<ul style="list-style-type: none"> • Energization of any new <i>facility</i> equipment impactive on the <i>reliability</i> and/or operability of the <i>IESO</i>-controlled grid, or • Returning into service replacements of any existing <i>facility</i> equipment impactive on the <i>reliability</i> and/or operability of the <i>IESO</i>-controlled grid.

- ~~testing of units currently on *outage*~~
- ~~tests of *facilities* providing *ancillary services*~~

All Equipment:

- Hold-off
- Energization:
 - ~~energization of any new *facility*, or~~
 - ~~energization of any new *facility* equipment impactive on the *reliability* and/or operability of the *IESO*-controlled grid; or~~
 - ~~returning into service replacements of any existing *facility* equipment impactive on the *reliability* and/or operability of the *IESO*-controlled grid.~~

– End of Appendix C –

Appendix B: Equipment Classes and Applicable Constraint Codes

Table C-1: Table B-1: Applicable Constraint Code per Equipment Class

Equipment Class	Constraint Code											
	OOS	IS	DRA TE	MUSTRU N	HOLDO FF	AVR/PS S-OOS	ASP OOS	PROT OOS	BF-PROT OOS	BTCT	INFO	ABNO
Line	X	X			X				X			X
Line Section	X	X	-	-	X	-	-	X	-	-	-	X
Breaker	X	X	-	-	-	-	-	-	X	X	X	X
Disconnect Switch	X	X	-	-	-	-	-	-	-	-	-	X
Bus	X	X	-	-	-	-	-	X	-	-	-	X
Transformer	X	X			-	-	-	X	-	-	-	X
Reactor	X	X	X	-	-	-	-	X	-	-	-	X
Capacitor	X	X	X	-	-	-	-	X	-	-	-	X
SVC	X	X	X	X	-	-	-	X	-	-	-	X
Converter	X	X	X	X	-	-	-	X	-	-	-	X
Filter	X	X	X	-	-	-	-	X	-	-	-	X

Equipment Class	Constraint Code											
	OOS	IS	DRATE	MUSTRUN	HOLDOFF	AVR/PSS	ASP	PROT	BF PROT	BTCT	INFO	ABNO
						OOS	OOS	OOS	OOS			
Phase Shifter	X	X	-	-	-	-	-	X	-	-	X	
Voltage Regulator	X	X	-	-	-	-	-	X	-	-	X	
UFLS Relay	X	X	-	-	-	-	-	-	-	-	X	
Synchronous Condenser	X	X	X	X-	-	-	-	X	-	-	X	
Generation <i>facility</i> Facility, Electricity Storage <i>facility</i> Facility	X	X	X	X	-	X	X	X	-	-	X	X
Load	X	X	X	X	-	-	-X	X	-	-	X	
AC/DC Station Service ²⁵	X	X	-	-	-	-	-	-	-	-	X	
SPS ²⁵	X	X	-	-	-	-	-	-	-	-	X	
Tone Communication Channels ²⁵	X	X	-	-	-	-	-	-	-	-	X	
RTU/ICCP/HUB Equipment ²⁵	X	X	-	-	-	-	-	-	-	-	X	
Other Communication Equipment ²⁵	X	X	-	-	-	-	-	-	-	-	X	

²⁵ Market participants are required to input a description of the equipment for this equipment class, in the outage management system.

<u>Equipment Class</u>	<u>Constraint Code</u>											
	<u>OOS</u>	<u>IS</u>	<u>DRATE</u>	<u>MUSTRUN</u>	<u>HOLDOFF</u>	<u>AVR/PSS</u>	<u>ASP</u>	<u>PROT</u>	<u>BF PROT</u>	<u>BTCT</u>	<u>INFO</u>	<u>ABNO</u>
						<u>OOS</u>	<u>OOS</u>	<u>OOS</u>	<u>OOS</u>			
Other Miscellaneous Equipment²⁵	X	X	-	-	-	-	-	-	-	-	X	

– End of Appendix B –

Appendix C: Criteria for ~~1~~One-Day Advance Approval, Auto AA and FAA

Planned outage requests containing only low-impact equipment must be submitted for ~~1-Day Advance Approval~~*one-day advance approval*. *Outage* requests containing eligible equipment, with no conflicting *outage* requests (~~See Section 3~~*refer to section 4.2 for outage* conflicts) and that satisfy low-impact criteria may be eligible to receive ~~Auto Advance Approval~~*auto advance approval* (Auto AA) (i.e. automatically transition to Advance Approved status on submission) and in some cases may also receive ~~Final Approval~~*final approval* in ~~Advance~~*advance* (FAA). -The eligibility criteria for ~~1-Day~~*one-day* advance approval, Auto AA and FAA are described in the table below.

Table ~~D-1~~C-1: Criteria for ~~1~~One-Day Advance Approval, Auto AA and FAA

A Outage Type	B Equipment Class	C Constraint Code	D Low-impact Attributes	E Additional Conditions	F 1 One-Day Advance Approval	H Auto AA	I FAA
Generator outage or Electricity <i>Storage</i> facility outage	Generation facility or Electricity <i>Storage</i> facility	OOS, IS, DRATE, MUST RUN		Planned Start and End Date/Time are in the same day or Max <i>Maximum</i> Recall ≤ 15 min <i>minutes or less</i>	Y	N	N

A Outage Type	B Equipment Class	C Constraint Code	D Low-impact Attributes	E Additional Conditions	F 1 One-Day Advance Approval	H Auto AA	I FAA
Available But Not Operating	<i>Generation facility or Electricity Storagestorage facility</i>	ABNO		Priority Code = Information	N	Y	N

A Outage Type	B Equipment Class	C Constraint Code	D Low-impact Attributes	E Additional Conditions	F 1 One-Day Advance Approval	H Auto AA	I FAA
<i>Automatic Voltage Regulation (AVR) or Power System Stabilizer (PSS)</i>	<i>Generation facility or Electricity Storage storage facility</i>	<i>AVR/PSS OOS</i>	<i>Only a Loss of Redundancy?" = YES (Answer)</i>		Y	Y	Y

A Outage Type	B Equipment Class	C Constraint Code	D Low-impact Attributes	E Additional Conditions	F 1 One-Day Advance Approval	H Auto AA	I FAA
<i>Ancillary Services</i>	<i>Generation facility, Load or Electricity</i> <i>Storage</i> <i>facility</i>	ASP OOS		Planned Start and End Date/Time are in the same day or Max Maximum Recall ≤is 15 min minutes or less	Y	N	N

A Outage Type	B Equipment Class	C Constraint Code	D Low-impact Attributes	E Additional Conditions	F 1 One-Day Advance Approval	H Auto AA	I FAA	
Primary protections	Line, Line Section Generation facility, or Electricity Storage facility, Bus, Transformer, Reactor, Capacitor, SVC, Phase Shifter Voltage Regulator , Synchronous Condenser, Converter, Filter, Load	PROT OOS	"Only a Loss of Redundancy?" = YES (Answer) "Only a Loss of Redundancy?" = YES (Answer)	Max Maximum Recall is ≤ 15 minutes Max Recall is → 15 minutes or less	Y Y	Y N	Y Y	
					<u>Maximum Recall is greater than 15 minutes</u>	<u>Y</u>	<u>N</u>	<u>Y</u>
Holdoffs	Line, Line Section	HOLDOFF			Y	Y	Y	

A Outage Type	B Equipment Class	C Constraint Code	D Low-impact Attributes	E Additional Conditions	F 1 One-Day Advance Approval	H Auto AA	I FAA
Breaker failure protections	Breaker	BF PROT OOS	<p>"Adjacent breakers OOS?" = NO (Answer) AND "Only a Loss of Redundancy?" = YES (Answer) ELSE, IF Question: "Only a Loss of Redundancy?" = NO (Answer) THEN "CTs on both sides of the breaker?" = YES (Answer)</p>	<p>Only one piece of Equipment is on the Outage Request Continuous and ≤ 4 hours in duration No overlapping BF PROT OOS <i>outages</i> at the same station</p>	Y	N	N
Breaker trip coil tests	Breaker	BTCT			Y	N	N
AC/DC station service	AC/DC Station Service	OOS	<p>"Only a Loss of Redundancy?" = YES (Answer) "Does the SS supply Cooling to any equipment on the ICG?" = YES (Answer)</p>	<p>MaxMaximum Recall is ≤ 15 minutes <u>or less</u></p>	Y	N	N

A Outage Type	B Equipment Class	C Constraint Code	D Low-impact Attributes	E Additional Conditions	F 1 One-Day Advance Approval	H Auto AA	I FAA
		OOS	"Only a Loss of Redundancy?" = YES (Answer) "Does the SS supply Cooling to any equipment on the ICG?" = NO (Answer)	Max Maximum Recall is ≤ 15 minutes <u>or less</u>	Y	Y	Y
		IS		Max Maximum Recall is ≤ 15 minutes <u>or less</u>	Y	N	N
Tone communication channels	Tone Communication Channels	OOS	Only a Loss of Redundancy?" = YES (Answer) "RTU or HUB Affected?" = YES (Answer)	Max Maximum Recall is ≤ 15 minutes <u>or less</u>	Y	N	N
		OOS	Only a Loss of Redundancy?" = YES (Answer) "RTU or HUB Affected?" = NO (Answer)	Max Maximum Recall is ≤ 15 minutes <u>or less</u>	Y	Y	Y
		IS		Max Maximum Recall is ≤ 15 minutes <u>or less</u>	Y	N	N
Radial lines	Transmission circuit	OOS, IS, DRATE		Facility Class = 3 (Low-impact)	Y	Y	N

A Outage Type	B Equipment Class	C Constraint Code	D Low-impact Attributes	E Additional Conditions	F 1 One-Day Advance Approval	H Auto AA	I FAA
Transmission facilities operated at voltages < 100 kV	Breaker, Bus, Disconnect Switch, Transformer, Load	OOS, IS, DRATE		Facility Class = 3 (Low-impact)	Y	Y	N
LV reactive devices	Capacitor, Reactor	OOS		Facility Class = 3 (Low-impact)	Y	N	N
UFLS equipment	UFLS Relay	OOS		Facility Class = 3 (Low-impact) UFLS Validation Threshold passes (i.e. Sum UFLS Area Outages < UFLS Area Outage Margin)	Y	Y	Y
Special Protection Scheme	SPS	OOS	Only a Loss of Redundancy?" = YES (Answer)	Max Maximum Recall is ≤ 15 minutes <u>or less</u>	Y	N	N
		IS		Max Maximum Recall is ≤ 15 minutes <u>or less</u>	Y	N	N
RTU/ICCP/HUB Equipment	RTU/ICCP/HUB Equipment	OOS	Only a Loss of Redundancy?" = YES (Answer)	Max Maximum Recall is ≤ 15 minutes <u>or less</u>	Y	N	N
		IS		Max Maximum Recall is ≤ 15 minutes <u>or less</u>	Y	N	N

A Outage Type	B Equipment Class	C Constraint Code	D Low-impact Attributes	E Additional Conditions	F 1 One-Day Advance Approval	H Auto AA	I FAA
Other Equipment	Other Communication Equipment, Other Miscellaneous Equipment	OOS	Only a Loss of Redundancy?" = YES (Answer)	Max Maximum Recall is ≤ 15 minutes <u>or less</u>	Y	N	Y
		IS		Max Maximum Recall is ≤ 15 minutes <u>or less</u>	Y	N	N

– End of Appendix –

List of Acronyms

Acronym	Term
<u>ABNO</u>	<u>available but not operating</u>
<u>AGC</u>	<u>automatic generation control</u>
<u>ASP OOS</u>	<u>ancillary service out-of-service</u>
<u>Auto AA</u>	<u>auto advance approval</u>
<u>AVR</u>	<u>automatic voltage regulation</u>
<u>AVR/PSS OOS</u>	<u>automatic voltage regulation or power system stabilizer out-of-service</u>
<u>BA</u>	<u>balancing authority</u>
<u>BF PROT OOS</u>	<u>breaker fail protection out-of-service</u>
<u>BTCT</u>	<u>breaker trip coil test</u>
<u>CRO</u>	<u>control room operator</u>
<u>DAM</u>	<u>day-ahead market</u>
<u>DRATE</u>	<u>derated to</u>
<u>DSO</u>	<u>Dispatch Scheduling Optimizer</u>
<u>EPT</u>	<u>Eastern Prevailing Time</u>
<u>EST</u>	<u>Eastern Standard Time</u>
<u>FAA</u>	<u>final approval in advance</u>
<u>HDR</u>	<u>hourly demand response</u>
<u>HOLDOFF</u>	<u>hold off</u>
<u>ICCP</u>	<u>Inter-Control Centre Communications Protocol</u>
<u>INFO</u>	<u>information</u>
<u>IS</u>	<u>in-service</u>
<u>kV</u>	<u>kilovolt</u>
<u>LV</u>	<u>low voltage</u>
<u>MUSTRUN</u>	<u>must run at</u>

<u>Acronym</u>	<u>Term</u>
<u>MVA</u>	<u>megavolt-amp</u>
<u>MVAR</u>	<u>megavolt-amp reactive</u>
<u>MW</u>	<u>megawatt</u>
<u>NERC</u>	<i><u>North American Electric Reliability Corporation</u></i>
<u>NPCC</u>	<i><u>Northeast Power Coordinating Council</u></i>
<u>OOS</u>	<u>out-of-service</u>
<u>ORA</u>	<i><u>operating reserve activation</u></i>
<u>PROT OOS</u>	<u>protection out-of-service</u>
<u>PSS</u>	<u>power system stabilizer</u>
<u>RC</u>	<u>reliability coordinator</u>
<u>RTU</u>	<u>remote terminal unit</u>
<u>SMO</u>	<i><u>segregated mode of operation</u></i>
<u>SPS</u>	<u>special protection system</u>
<u>SVC</u>	<u>static VAR compensators</u>
<u>TS</u>	<u>transmission station</u>
<u>UFLS</u>	<u>underfrequency <i>load</i> shedding</u>
<u>VAR</u>	<u>volt-amp reactive</u>

– End of Section –

References

Document ID & Link	Document Title
MDP_RUL_0002	Market Rules for the Ontario Electricity Market
PRO-408 PRO-408	Market Manual 1.5: Market Registration Procedures
MDP_PRO_0017	Market Manual 2.1: Dispute Resolution
IMO_PRO_0019	Market Manual 2.2: Exemption Application and Assessment
MDP_PRO_0022	Market Manual 2.6: Treatment of Compliance Issues
MDP_PRO_0023	Market Manual 2.7: Treatment of Market Surveillance Issues
IMP_PRO_0024	Market Manual 2.11: Reliability Outlook and Related Information Requirements
MDP_PRO_0033	Market Manual 5.5: Physical Markets Settlement Statements
IMP_PRO_0033 TBD	Market Manual 7 4 .2: Near-Term Assessments and Reports Operation of the Day-Ahead Market
IESO_MAN_0077 IMP_POL_0002	Market Manual 9 7 .2: Submitting Operational and Market Data for the DACP 7.4: IESO-Controlled Grid Operating Policies
MAN-44	Market Manual 12.0: Capacity Auctions
PRO-357 PRO-357	Market Manual 13.1: Capacity Export Requests
N/A	Electricity Act, 1998
IESO_TPL_0020	IESO – Ancillary Service Provider (ASP) Agreement for Procurement of Certified Black Start Facilities
GDE-259	Outage Coordination and Scheduling System (OCSS) CROW Web Client User Guide

– End of Document –